

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A
ELCA_Engine ver.4.5.6.0



FX-W-G05 0551 - 1752

124-401 kW
Water cooled chiller

R R513A

SCREW

T SHELL & TUBES



(The photo of the unit is indicative and may vary depending on the model)

- ✓ **LOW GWP REFRIGERANT**
- ✓ **ErP READY**
- ✓ **MAXIMUM COMPACTNESS**

- ✓ **ELECTRONIC EXPANSION VALVE
SUPPLIED STANDARD**
- ✓ **ADAPTABILITY**

1	CERTIFICATIONS	pg.5
1.1	Product certifications	pg.5
1.2	Voluntary product certifications	pg.5
1.3	System certifications	pg.5
2	PRODUCT PRESENTATION	pg.7
2.1	Green certification relevant	pg.7
2.2	Unit description	pg.8
2.3	Key features	pg.8
2.4	Operating principle	pg.9
3	ICIPIT	pg.11
4	UNIT DESCRIPTION	pg.12
4.1	Standard unit composition	pg.12
4.2	Configurations	pg.15
4.3	Electronic controller	pg.16
5	OPTIONS	pg.18
5.1	Options	pg.18
5.2	Options - additional information	pg.27
6	GENERAL TECHNICAL DATA	pg.31
7	TECHNICAL DATA SEASONAL EFFICIENCY IN COOLING (EN14825 VALUE)	pg.33
8	OPERATING LIMITS	pg.34
8.1	Operating limits	pg.34
9	HYDRAULIC DATA	pg.37
10	ELECTRIC DATA	pg.38
10.1	Electrical data	pg.38
11	FULL LOAD SOUND LEVEL	pg.39
12	DIMENSIONAL DRAWINGS	pg.40
12.1	Dimensional drawings	pg.40
12.2	Legend of pipe connections	pg.58

13	ATTACHMENTS	pg.60
13.1	Variable flow control	pg.60
13.2	Condensation control devices	pg.70

Liability disclaimer

The present publication is drawn up by of information only and does not constitute an offer binding upon Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A.

Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. has compiled the content of this publication to the best of its knowledge. The data contained herein are subject to change without notice. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A.

The units highlighted in this publication contain R513A [GWP₁₀₀ 572] fluorinated greenhouse gases.

LEGEND**Data Book**

FX-W-G05 0551 - 1752_202109_EN R513A

Functions

Cooling

Refrigerant

R513A

Compressors

Screw compressor

Exchangers

Shell & Tubes

Other features

Eurovent



VPF



Electronic Expansion Valve

1.1 Product certifications



1.2 Voluntary product certifications



Check ongoing validity of certificate:
www.eurovent-certification.com
or
www.certiflash.com

1.3 System certifications



Quality System complying with the requirements of UNI EN
ISO9001:2008 regulation



Environmental Management System complying with the requirements of UNI EN ISO14001:2004 regulation



Occupational Health and Safety Management System complying with the requirements of BS OHSAS 18001:2007

2.1 Green certification relevant

FOCUS ON GREEN CERTIFICATION RELEVANT

Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., as a major player in the world HVAC market and a leading manufacturer of energy efficient, sustainable HVAC solutions, recognizes and supports the diffusion of green certification systems, as an effective way to deliver high performance buildings and improve the quality and the sustainability of the built environment.

Since the first certification system was introduced at the beginning of the 1990s, the demand for certified buildings has grown considerably, as well as the number of standards, rating and certification programs. Operating worldwide Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., has extensive experience with many of them and is active member of Green Building Council Italy.

Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., commitment to develop responsible and sustainable HVAC solutions, is reflected by a full range of premium efficiency products and systems, designed with special care to improve building energy performance ratings, according to major certification protocols, including LEED, BREAM, GREENSTAR, BCA, NABERS, DNGB, HQE and BEAM.

To find out more about how our products contribute to enhanced green certification rating and energy performance of a building, please refer to:
https://www.melcohit.com/EN/Environment/green_certifications/



2.2 Unit Description

Indoor unit for the production of chilled water featuring semihermetic screw compressors optimized to operate with low compression ratio and R513A, shell and tubes evaporator designed by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. and shell and tube condenser and electronic expansion valve. Base and supporting structure are made of polyester painted galvanized steel. Eurovent certification. The unit is extremely compact, thanks to the peculiar construction layout, without base frame and panels, and extremely flexible to easily adapt itself to different thermal load conditions thanks to the precise thermoregulation. The high performance's level is achieved thanks to the accurate sizing of all internal components.

2.3 Key Features

LOW GWP REFRIGERANT

New generation refrigerant R513A, with reduced greenhouse effect in comparison with traditional HFC refrigerants (Global Warming Potential GWP of R513A = 572, GWP of R134a = 1300 as per IPCC rev. 5) and zero impact on the ozone layer. Non-flammable (ASHRAE 34, ISO 817: class A1).

ErP READY

Thanks to the high level of efficiency at part loads, the unit meets and exceeds the minimum energy efficiency threshold rated by the Seasonal Energy Efficiency Ratio SEER, in accordance with the eco-sustainable design requirements for all products using energy. For this reason, the unit represents the best choice for all the hydronic installations in the residential and commercial air conditioning systems.

MAXIMUM COMPACTNESS

Maximum compactness offers very high flexibility in the design process and installation operations, offering a premium solution in case of reduced clearances or when retrofitting existing installations.

ELECTRONIC EXPANSION VALVE SUPPLIED STANDARD

The electronic expansion valve brings several benefits especially in case of variable thermal load conditions and source temperature. It improves the efficiency of the unit and reduces power consumption, and allows a faster start-up time and wider operating limits.

ADAPTABILITY


Can adapt to the building's cooling request thanks to the continuous capacity regulation, assured by the control's sophisticated logic.

2.4 Operating principle

CONFIGURATIONS

- , standard unit

No heat recovery is possible.

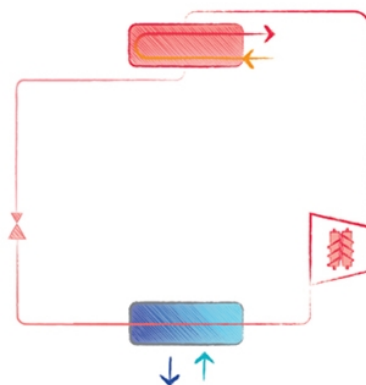


/D, unit with partial heat recovery

Each refrigerant circuit is fitted with a desuperheater.


The superheating heat recovery is only possible when the temperature of the hot water circuit is lower than the compressor discharge temperature. The heat recovery and its amount depends on the unit's operating conditions, in particular the outdoor air temperature and the load percentage. It is advised to interrupt the water flow to the desuperheater when the conditions for an actual heat recovery are not met.

The smart management of the desuperheater pump(s) is possible with the option 3371 D – RELAY 1 PUMP (ON/OFF), further information is available in the bulletin section dedicated to accessories.

Heat recovery: ON

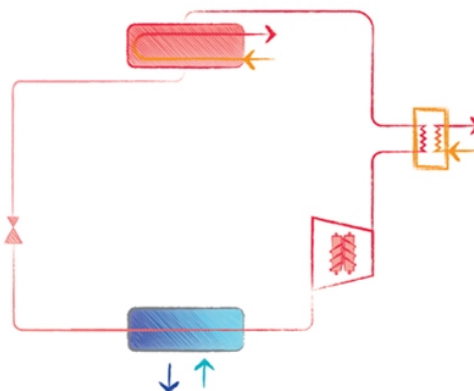

Heat recovery: OFF (water flow stopped)

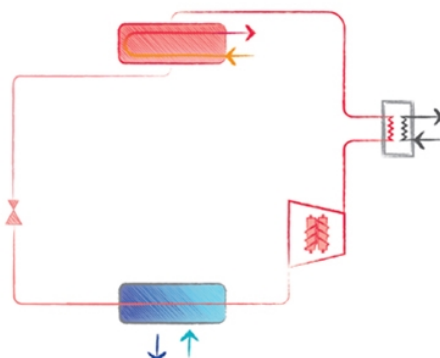


/R, unit with total heat recovery

The unit is provided with a dual-condenser with two hydraulic connections (water inlet/outlet) for the condenser and two hydraulic connections for the total heat recovery. When the heat recovery mode is active, the condensation takes place in the devoted refrigerant/water heat exchanger instead of in the standard condenser.


Each refrigerant circuit is fitted with a total heat recovery exchanger.

The heat recovery mode is managed in accordance with the hot water temperature set-point and has to be managed on site.

Total heat recovery

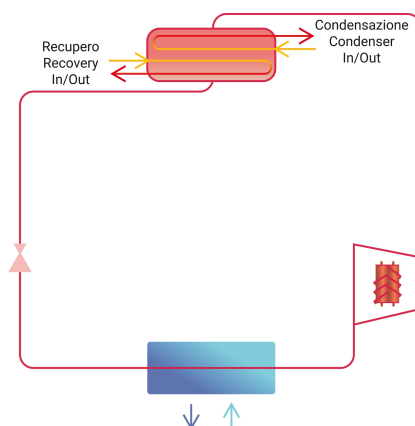

FX-W-G05 / R / 1752

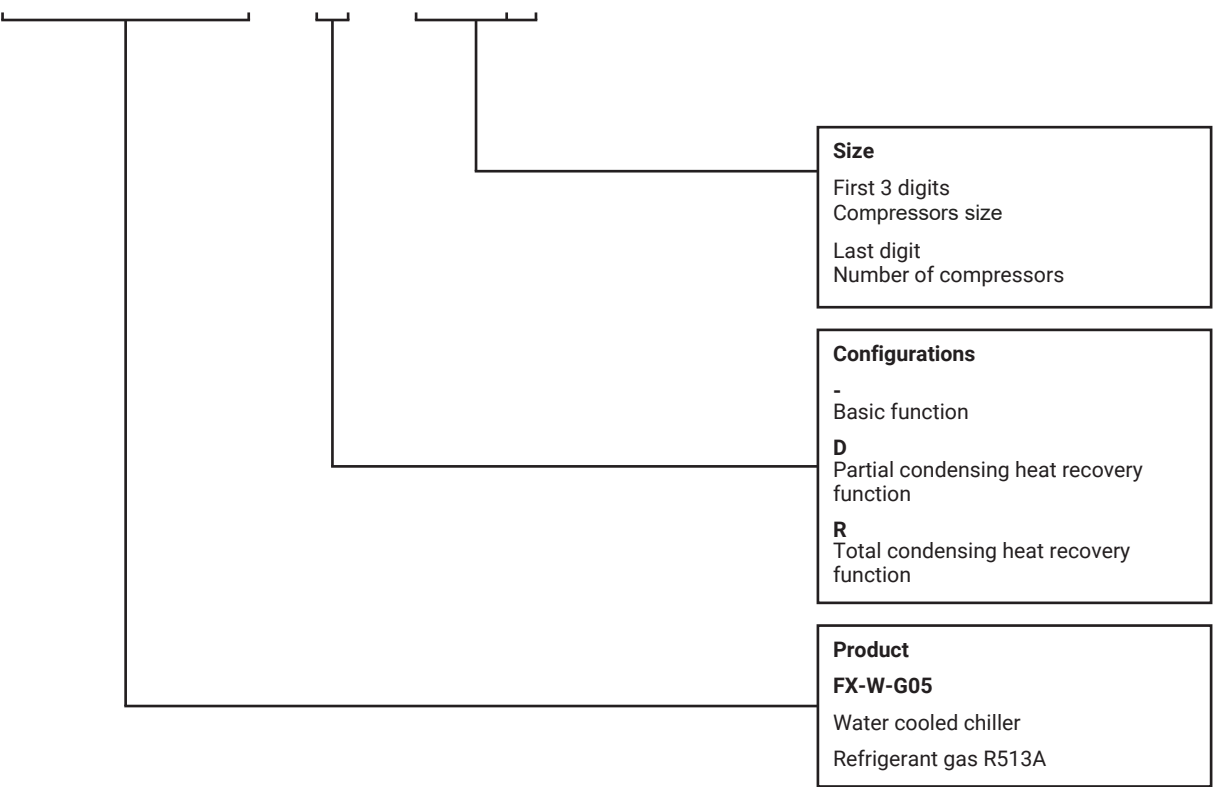

4.1 Standard unit composition

Water cooled chiller

Indoor unit for the production of chilled water featuring semihermetic screw compressors optimized to operate with low compression ratio and R513A, shell and tubes evaporator designed by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. and shell and tube condenser and electronic expansion valve.

Base and supporting structure are made of polyester painted galvanized steel. Eurovent certification. The unit is extremely compact, thanks to the peculiar construction layout, without base frame and panels, and extremely flexible to easily adapt itself to different thermal load conditions thanks to the precise thermoregulation. The high performance's level is achieved thanks to the accurate sizing of all internal components.

Installation note

The unit is supplied fully refrigerant charged and factory tested. On site installation only requires power and hydraulic connection.

Structure

Frame in polyester-painted galvanized steel.

The self-supporting frame is built to guarantee maximum accessibility for servicing and maintenance operations.

Refrigerant circuit

Unit designed with separate and independent refrigerant circuits in order to ensure continuous operation and easy maintenance. In addition to the main components described in the following sections, each refrigerant circuit is fitted as standard with:

- Electronic expansion valve
- High and low pressure safety valve
- liquid line shut-off valve
- compressor's discharge valve
- drier filter with replaceable cartridge
- refrigerant line sight glass with humidity indicator
- High pressure switches
- non -return valve in compressor's discharge line integrated in the compressor
- high and low pressure transducers
- high and low pressure gauges
- liquid line shut-off device (function performed by electronic expansion valve with ultracap)

UNIT DESCRIPTION


Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

Compressor

New semi-hermetic screw compressors designed for high efficiency in low condensing temperature applications.

Semi-hermetic screw compressors with 2 five- and six-lobe rotors: the five-lobe rotor is splined directly onto the motor (nominal speed 2950 rpm) without the use of interposed gears. The bearings provided along the rotor axis in a separate chamber isolated from the compression chamber, are made in carbon steel (lifetime higher than 150.000h at full load). Optimized lubrication guarantees oil's distribution between mechanical parts, without using an oil pump; the built-in oil separator has 3 stages of separation, and a 10 mm stainless steel mesh filter ensures the constant presence of oil inside. Cooling power is partialized by a slide valve which, depending on the position assumed, permits a stepless compression chamber reduction; each compressor can therefore smoothly partialize from 25% to 100% of its capacity (option available as accessory for units with 2 circuits). The two pole motors are fitted as standard with electric devices to limit the absorbed current during compressor start-up, and with unloaded start-up. Each compressor is fitted with manual-reset motor thermal protection, delivery gas temperature and oil level controls and an electric resistance for the carter's heating while the compressor is stopped. A check valve fitted on the refrigerant delivery line prevents the rotors from reversing after stopping. On-off cock on the delivery line of each compressor (external to the compressor itself) to isolate the refrigerant charge in the heat exchanger when required.

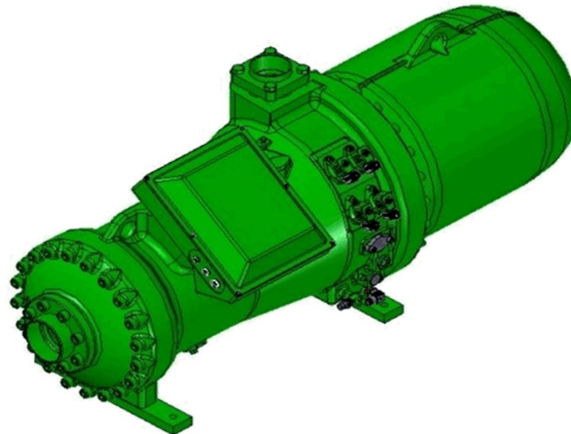

Plant side heat exchanger

Shell and tube heat exchanger, fully designed and manufactured by Mitsubishi Electric Hydronics & IT Cooling Systems, working as direct expansion evaporator, with refrigerant flowing inside the pipes and water flowing in the shell side. Baffles in the shell increase turbulence and therefore enhance the heat exchange's efficiency. The steel shell is insulated with a foamed polyethylene closed-cell mat of 9 mm thickness and a thermal conductivity of 0,033 W/mK at 0°C. The copper pipes are internally grooved to improve the heat exchange and mechanically fitted onto the plates. A differential pressure switch is present as standard to control the water flow while the unit is working, avoiding the risk of ice generation. The heat exchanger complies with PED standards, concerning the operating pressures. Flexible joint water connections.

Source side heat exchanger

Shell and tube heat exchanger working as condenser, with water flowing inside and refrigerant flowing outside the pipes. Heads can be removed to inspect the pipes. Standard water connections are suitable for water with temperature difference of 5°C. Under request it is possible to have a 4-passes heat exchanger (water side) for applications with temperature difference higher than 10°C. The heat exchanger complies with PED standards, concerning the operating pressures. GAS threaded water connections.

UNIT DESCRIPTION

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

Electrical and control panel

Electrical and control panel built in accordance with EN60204-1 standard, complete with:

- power supply 400V/3ph/50Hz and part-winding compressors start-up
- Electronic control W3000+
- general door lock isolator
- control circuit transformer
- power circuit with electric bus bar distribution system
- fuses for compressors
- compressors protection with internal thermal overload
- terminals for cumulative alarm block
- remote ON/OFF terminals
- spring-type control circuit terminal board
- Phases sequence control
- relays for voltage monitoring
- bottom cable entry
- IP21 BW protection (Protected against solid objects over 12 mm and vertically falling drops of water).

Certification and applicable directives

The unit complies with the following directives and relative amendments:

- EUROVENT Certification program
- ErP Directive 2009/125/EC
- CE - Declaration of conformity certificate for the European Union
- EAC - Product quality certificate for Russian Federation
- Machine directive 2006/42/EC
- PED directive 2014/68/EU
- Low Voltage directive 2006/95/EC
- ElectroMagnetic compatibility directive 2004/108/EC
- F-Gas Regulation 517/2014/EC
- 811/2013/EC and 813/2103/EC EcoLabelling Regulations
- ISO 9001 - Company Quality Management System certification
- ISO 14001 - Company Environmental Management System certification

Tests

Tests performed throughout the production process, as indicated in ISO9001.

Performance or noise tests can be performed by highly qualified staff in the presence of customers.

Performance tests comprise the measurement of:

- electrical data
- water flow rates
- working temperatures
- power input
- power output
- pressure drops on the water-side exchanger both at full load (at the conditions of selection and at the most critical conditions for the condenser) and at part load conditions.

During performance testing it is also possible to simulate the main alarm states.

Noise tests are performed to check noise emissions according to ISO9614.

4.2 Configurations

- , standard unit

Standard unit for production of chilled water

/D, unit with partial heat recovery

Unit for the production of chilled water, equipped with an auxiliary heat exchanger (desuperheater) on the compressor discharge for superheat recovery. The recovered heat is approximately the 20% of the total cooling capacity and can be used for domestic hot water production or other secondary uses, such as the integration of an existing boiler.

/R, unit with total heat recovery

Unit for the production of chilled water, with a dedicated heat exchanger refrigerant/water for the condensation heat reclaim. The heat reclaim is managed to reach the set-point. This function is used for air treatment in applications with AHU or for domestic hot water production together with an auxiliary boiler.

UNIT DESCRIPTION

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

4.3 Electronic controller


Electronic control W3000+

The brand new W3000+ controller offers advanced functions and algorithms. The Large keypad, as standard, features function controls and a complete LCD display to view data and activate the unit, via a multi-language menu. In addition to or as an alternative, KIPLink - Keyboard In Your Pocket - is available. It is an innovative user interface based on WiFi technology that allows one to operate on the unit directly from a smartphone or tablet. Using KIPLink, it is possible to turn the unit on and off, adjust the set-point, plot the main operating variables, monitor the status of the refrigerant circuits and compressors, and display and reset the possible alarms.

Diagnostics include complete alarm management, with “blackbox” functions (via PC) and alarm log (display or PC) for best analysis of unit behavior. The built-in clock can be used to create an operating profile containing up to 4 typical days and 10 time bands, essential for efficient programming of energy production. Optional proprietary devices can perform the adjustment of the resources in systems comprised of several units. Consumption metering and performance measurement are possible as well, and supervision can be easily developed via proprietary devices or the integration in third party systems by means of the most common protocols as ModBus, Bacnet, Bacnet-over-IP, LonWorks, M-Net. A dedicated optional wall-mounted keypad can be used as a remote control of all the functions.

The regulation features the continuous modulation of capacity, based on sequential adjustment + DIP referring to the leaving water temperature.

Optionally (VPF package) the variable primary flow control is available.

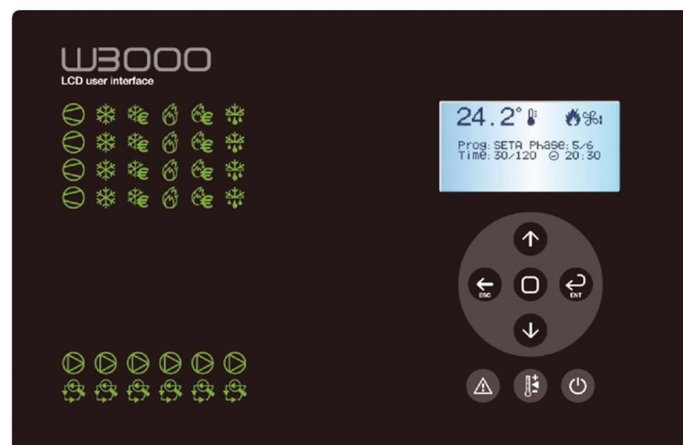

Touch screen

As an alternative to the Large keyboard, the unit can be equipped with the Touch interface, with a 7" WVGA colour display and a front USB port. The touch-screen's technology is characterized by an easy-to-access data, and it allows an effective graphical representation of the main figures protecting the access through 3 privilege levels.



KIPlink - Keyboard In your Pocket

KIPlink - Keyboard In Your Pocket - is the innovative user interface based on WiFi technology that allows one to operate on the unit directly from the smartphone or tablet. It is available in addition to or as an alternative to the Large or Touch Keyboard. Using KIPlink, it is possible to turn the unit on and off, adjust the set-point, plot the main operating variables, monitor in detail the status of the refrigerant circuits, the compressors and display and reset the possible alarms.



5 OPTIONS**Data Book**

FX-W-G05 0551 - 1752_202109_EN R513A

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
1020 REGULATIONS			
1016 UNIT WITH PED RULES	Unit according to PED (Pressure Equipment Directive) rules		ALL
1017 UNIT PED-UDT COMPLIANT	Unit PED-UDT compliant for Polish market		ALL
380 NUMBERED WIRING			
381 NUMBERED WIRING ON EL. BOARD	Electrical board wires are identified by numbered labels. The reference numbers are indicated in the unit's wiring scheme.	Facilitate maintenance interventions to the electrical board connections.	ALL
382 PWR WIRINGS ACC.TO UK REQUEST		Facilitate maintenance interventions to the electrical board connections.	ALL
383 NUMBERED WIRINGS+UK REQUESTS	Electrical board wires are identified by numbered labels. The reference numbers are indicated in the unit's wiring scheme.	Facilitate maintenance interventions to the electrical board connections.	ALL
3300 COMPRESSOR REPHASING			
3301 COMPR.POWER FACTOR CORR.	Capacitors on the compressors' power inlet line.	The unit's average cos(phi) increases.	ALL
3410 AUTOMATIC CIRCUIT BREAKERS			
3412 AUTOM. CIRCUIT BREAK. ON LOADS	Over-current switch on the major electrical loads.	In case of overcurrent allows resetting of the switch without the replacement of relative fuses.	ALL
3600 COMPRESSOR RUN STATUS SIGNAL			
3601 COMPRESSOR OPERATION SIGNAL	Auxiliary contacts providing a voltage-free signal.	Allows remote signalling of compressor's activation or remote control of any auxiliary loads.	ALL
4180 REMOTE CONNECTION ARRANGEMENT			
4181 SERIAL CARD MODBUS	Interface module for ModBUS protocols.	Allows integration with BMS operating with ModBUS protocol.	ALL
4182 SERIAL CARD FOR LONWORKS	Interface module for Echelon systems.	Allows integration with BMS operating with LonWorks protocols	ALL
4184 SERIAL CARD BACNET MS/TP RS485	Interface module for BACnet protocols.	Allows integration with BMS operating with BACnet protocol.	ALL
4185 SERIAL CARD FOR BACNET OVER IP	Interface module for BACnet OVER-IP protocols.	Allows to interconnect BACnet devices over Internet Protocol within wide-area networks.	ALL
4187 M-Net W3000 INTERFACE KIT	Interface kit for M-Net protocol.	Interface module to allow the integration of the unit with Mitsubishi Electric proprietary communication protocol M-Net.	ALL
6160 AUXILIARY INPUT			
6161 AUXILIARY SIGNAL 4-20mA	4-20 mA analog input	Allows to change the operating set-point according to the value of current applied to the analogue input.	ALL
6162 REMOTE SIGNAL DOUBLE SP	Allows to activate the Energy Saving set-point.	Allows to change the operating set-point according to a remote switch	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
6170 DEMAND LIMIT			
6171 INPUT REMOTE DEMAND LIMIT	Digital input (voltage free)	It permits to limit the unit's power absorption for safety reasons or in temporary situation.	ALL
1510 SOFT-STARTER			
1511 UNIT WITH SOFT-START	Electronic device adopted to manage the inrush current. The device controls 2 phases.	Break down of the inrush current compared to the direct motor start, lower motor windings' mechanical wear, avoidance of mains voltage fluctuations during starting, favourable sizing for the electrical system.	ALL
5920 MANAGEMENT & CONTROL SYSTEMS			
5922 ClimaPRO ModBUS RS485 - MID	This option includes the following devices on-board the unit panel: - MID certified network analyzer operating on ModBUS over RS-485 - Current transformers - Software release LA09 or later version.	This accessory allows to acquire the electrical data and the power absorbed by the unit and communicate with ClimaPRO via high level communication interface based on ModBUS over EIA RS-485. More specifically, the data collected are: power supply, current, frequency, power factor (cos), electrical power consumption, energy consumption. This specific energy meter model is MID certified and can therefore be used for billing applications. This option also ensures the compatibility between the units and ClimaPRO, thus allowing ClimaPRO to acquire all the main unit's operating variables and status by means of a high level communication interface to the controller installed onboard the unit panel.	ALL
5923 ClimaPRO BacNET over IP	This option includes the following devices on-board the unit panel: - network analyzer operating on BACnet over IP - Current transformers - Software release LA09 or later version.	This accessory allows to acquire the electrical data and the power absorbed by the unit and communicate with ClimaPRO via high level communication interface based on BACnet over IP. More specifically, the data collected are: power supply, current, frequency, power factor (cos), electrical power consumption, energy consumption. This network analyzer is not MID certified and cannot therefore be used for billing applications. This option also ensures the compatibility between the units and ClimaPRO, thus allowing ClimaPRO to acquire all the main unit's operating variables and status by means of a high level communication interface to the controller installed onboard the unit panel.	ALL
5924 ENERGY METER FOR BMS	This option includes the following devices on-board the unit panel: - network analyzer with display operating on ModBUS protocol over RS-485 (without certification MID) - current transformers.	This accessory allows to acquire the electrical data and the power absorbed by the unit and send them via RS-485 bus to the BMS for energy metering.	ALL
1900 COMPRESSOR SUCTION VALVE			
1901 COMPRESSOR SUCTION VALVE	Shut-off valve on compressor's suction circuit.	Simplifies maintenance activities	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
1280 CONDENSER CONFIGURATION			
1281 2 PASS CONDENSER	Inlet and outlet water connections on the same head	Inlet and outlet water connections on the same head	ALL
1283 4 PASS CONDENSER	Water realizes 4 tube side passes	Compatible with water with high delta temperature	ALL
1200 WATER CONDENSER TYPE			
1201 Cu/Ni 90/10 WATER CONDENSER	Shell and tube heat exchanger recommended for applications with water with an high corrosion potential. Headers, shell, baffles and refrigerant connection in carbon steel. [Consider a penalization on the condensation temperature of 2,5°C (/CA version) and 2,0°C (/CA-E) for 90/10]		ALL
1800 EVAPORATOR WATER FLOW SWITCH			
1801 EVAPORATOR WATER FLOW SWITCH	Flow switch with stainless scoop AISI 316L and IP65 protection suitable for installation in industrial plant pipes. It should be installed in a straight pipe without filters, valves, etc., long at least 5 times its diameter, both upstream and downstream.	Signaling of lack of or excessive reduction of flow, it generates an alarm that is in automatic or manual reset depending on n ° alarms per hour and the maximum time of operation of the pump under conditions of low flow rate.	ALL
1802 EVAP.DIFFERENTIAL PRESS.SWITCH	Differential pressure switch in silicone membrane, compatible for water and glycolated solutions, suitable to the horizontal and vertical mounting, with an operating range between -20 ° C and + 85 ° C.		ALL
2630 INSULATION ON EXCHANGERS			
2631 DOUBLE INSULATION ON EXCHANGERS	Thermal insulation in closed-cell flexible elastomeric foam (FEF) of 16 mm coupled with a 3 mm layer of reticulated foam in PE and an exterior embossed finishing PE film. This option is mandatory if the unit is supposed to work with outdoor temperature below -10°C.	Reduces heat losses and prevent from condensate problems.	ALL
2900 WATER CONNECTIONS			
2903 EVAP.FLANGES + COUNTERFLANGES			ALL
2340 UNIT ENCLOSURE			
2301 COMPRESS .ACOUSTICAL ENCLOSURE	Enclosure made from hot galvanised metal plate and painted with epoxy powder coat. The acoustic insulation availability depends on unit model, see the dedicated description in "Accessories notes".	It reduces the noise emissions and improves aesthetics.	ALL
4700 EV - HYDRONIC MODULE			
4701 EV - NO PUMPS, NO CONTACTS	Evaporator hydronic module, compatible with constant flow control. The unit is provided without any water flow regulation device.	Constant water flow is to be provided by others.	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4702 EV - RELAY 1 PUMP (ON/OFF)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 1 relay to control the activation of 1 external pump via single ON/OFF signal.	The hydronic module controls the external pumps with the unit controller logic.	ALL
4703 EV - RELAY 2 PUMPS (ON/OFF)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 2 relays to control the activation of 2 external pumps via double ON/OFF signal. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module controls the external pumps with the unit controller logic.	ALL
4713 EV - RELAY 1 PUMP + 0-10V SIG	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 1 relay and a 0-10V signal terminal to control the activation and the speed of 1 external variable speed pump.	The hydronic module controls the external pumps with the unit controller logic.	ALL
4714 EV - RELAY 2 PUMPS + 0-10V SIG	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 2 relays and a 0-10V signal terminal to control the activation and the speed of 2 external variable speed pump. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module controls the external pumps with the unit controller logic.	ALL
4860 EV - PRIMARY FLOW CONTROL			
4861 EV - CONSTANT FLOW	Evaporator water flow control (plant primary circuit): constant flow. Compatible with hydronic modules without regulation devices (no pumps, no contacts), with ON/OFF regulation devices (relays) or with fixed speed pumps (codes: 4701, 4702, 4703, 4704, 4705, 4706, 4707, 4708, 4709, 4711, 4712 - hydronic modules availability depends on unit model).	The unit is set up to operate with a constant water flow in the heat exchanger (plant primary circuit). This is the only option available in case of unit without any water flow regulation devices (no pumps, no contacts), which means with water flow control provided by others. In case of unit with ON/OFF regulation devices or fixed speed pumps, the unit controller manages the pump activation to reduce pump consumption.	ALL
4862 EV - CONSTANT FLOW (PARAMETER)	Evaporator water flow control (plant primary circuit): constant flow (parameter set). Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).	The unit is set up to operate with a constant water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal. The option provides the possibility to set the pump speed with a controller parameter. Once set, the speed pump remains constant until the next parameter adjustment. The parameter set constant flow control is useful during the unit installation and commissioning, to adjust water flow and pressure head according to the real plant characteristics.	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4864 EV – VPF (w/o DP)(SU, MM_PR)	<p>Evaporator water flow control (plant primary circuit): variable flow (delta P control). Only for single unit systems or unit with option 1541 (Multi Manager - Priority Master) if available.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: differential pressure transducer on the unit's heat exchanger and related controller expansion board, controller expansion board to read the plant side differential pressure transducer (4-20mA signal) and manage the hydraulic by-pass valve opening (0-10V signal).</p> <p>Compulsory equipment, supplied by others: plant side differential pressure transducer, plant side hydraulic by-pass valve.</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit).</p> <p>The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF (Variable Primary Flow) function. It keeps the delta P constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF function is applicable in systems with only the primary circuit. Further information available in the dedicated bulletin section.</p>	ALL
4865 EV – VPF (w DP)(SU, MM_PR)	<p>Evaporator water flow control (plant primary circuit): variable flow (delta P control). Only for single unit systems or unit with option 1541 (Multi Manager - Priority Master) if available.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: differential pressure transducer on the unit's heat exchanger and related controller expansion board, plant side differential pressure transducer (installation by others), controller expansion board to read the plant side differential pressure transducer (4-20mA signal) and manage the hydraulic by-pass valve opening (0-10V signal).</p> <p>Compulsory equipment, supplied by others: plant side hydraulic by-pass valve.</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit).</p> <p>The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF (Variable Primary Flow) function. It keeps the delta P constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF function is applicable in systems with only the primary circuit. Further information available in the dedicated bulletin section.</p>	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4866 EV – VPF (M3000, CPRO, MM_N-PR)	<p>Evaporator water flow control (plant primary circuit): variable flow (delta P control). Only for multi-unit systems with external controller (Manager3000 or ClimaPRO) or unit with option 1542 (Multi Manager - Non Priority Master) if available.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: differential pressure transducer on the unit's heat exchanger and related controller expansion board.</p> <p>It shall be the customer responsibility to configure the multi-unit control system (Manager3000, ClimaPRO or Multi Manager Priority Master) with option VPF.</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF (Variable Primary Flow) function. It keeps the delta P constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF function is applicable in systems with only the primary circuit. Further information available in the dedicated bulletin section.</p>	ALL
4867 EV - VPF.D (SU, MM_PR)	<p>Evaporator water flow control (plant primary circuit): variable flow (delta T control). Only for single unit systems or unit with option 1541 (Multi Manager - Priority Master) if available.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: 2 plant side NTC temperature sensors (installation by others).</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF.D (Variable Primary Flow with Decoupler) function. It keeps the delta T constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF.D function is applicable in systems with the primary and secondary circuits separated by a hydraulic decoupler. Further information available in the dedicated bulletin section.</p>	ALL
4868 EV - VPF.D(M3000, CPRO, MM_N-PR)	<p>Evaporator water flow control (plant primary circuit): variable flow (delta T control). Only for multi-unit systems with external controller (Manager3000 or ClimaPRO) or unit with option 1542 (Multi Manager - Non Priority Master) if available.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>It shall be the customer responsibility to configure the multi-unit control system (Manager3000, ClimaPRO or Multi Manager - Priority Master) with option VPF.D.</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF.D (Variable Primary Flow with Decoupler) function. It keeps the delta T constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF.D function is applicable in systems with the primary and secondary circuits separated by a hydraulic decoupler. Further information available in the dedicated bulletin section.</p>	ALL
4760 CD - HYDRONIC MODULE			
4761 CD - NO PUMPS, NO CONTACTS	<p>Condenser hydronic module, compatible with constant flow control.</p> <p>The unit is provided without any water flow regulation device.</p>	<p>Constant water flow is to be provided by others.</p>	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4762 CD - RELAY 1 PUMP (ON/OFF)	Condenser hydronic module, compatible with constant flow control. The unit is provided with 1 relay to control the activation of 1 external pump via single ON/OFF signal.	The hydronic module controls the external pumps with the unit controller logic.	ALL
4763 CD - RELAY 2 PUMPS (ON/OFF)	Condenser hydronic module, compatible with constant flow control. The unit is provided with 2 relays to control the activation of 2 external pumps via double ON/OFF signal. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module controls the external pumps with the unit controller logic.	ALL
4773 CD - RELAY 1 PUMP + 0-10V SIG	Condenser hydronic module, compatible with constant or variable flow control. The unit is provided with 1 relay and a 0-10V signal terminal to control the activation and the speed of 1 external variable speed pump.	The hydronic module allows to control the external pumps with the unit controller logic. In case of water cooled chiller, the 0-10V signal, it allows to manage several condensing devices in order to maintain the condensing pressure in a pre-defined range in every applications: - for well water application to manage a 2 way modulating valve; - for cooling tower application to manage a 3 way modulation valve; - for dry-cooler or cooling tower application to modulate the fans' speed.	ALL
4774 CD - RELAY 2 PUMPS + 0-10V SIG	Condenser hydronic module, compatible with constant or variable flow control. The unit is provided with 2 relays and a 0-10V signal terminal to control the activation and the speed of 2 external variable speed pump. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module allows to control the external pumps with the unit controller logic. In case of water cooled chiller, the 0-10V signal, it allows to manage several condensing devices in order to maintain the condensing pressure in a pre-defined range in every applications: - for well water application to manage a 2 way modulating valve; - for cooling tower application to manage a 3 way modulation valve; - for dry-cooler or cooling tower application to modulate the fans' speed.	ALL
4900 CD - COND. WATER FLOW CONTROL.			
4903 CD - 2 WAY MODULATING VALVE A	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
4904 CD - 2 WAY MODULATING VALVE B	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
4905 CD - 2 WAY MODULATING VALVE C	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
4906 CD - 2 WAY MODULATING VALVE D	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
4907 CD - 2 WAY MODULATING VALVE E	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
4908 CD - 2 WAY MODULATING VALVE F	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
4909 CD - 2 WAY MODULATING VALVE G	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL

OPTIONS

ELCA_Engine ver.4.5.6.0

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4911 CD - 2 WAY MODULATING VALVE H	Two way servo-motorized valve with steel body.	It's recommended in case of inverter pumps and water flow modulation.	ALL
491B CD - 0-10V SIGN. (1 X CIRCUIT)	0-10V signal on terminal board for the condensation control of the single circuit	The 0-10V signal, it allows to manage several condensing devices in order to maintain the condensing pressure in a pre-defined range in every applications: - for well water application to manage a 2 way modulating valve; - for cooling tower application to manage a 3 way modulation valve; - for dry-cooler or cooling tower application to modulate the fans' speed; - for geothermal probe to modulate the pumps' speed.	ALL
491C			ALL
1440 USER INTERFACE			
1442 KIPLink +7 INCH TOUCH SCREEN	In addition to KIPLink, the innovative user interface based on WiFi technology, the unit is equipped with the Touch interface, with a 7" WVGA colour display and a front USB port (WARNING: with outdoor temperature below 0°C the display response time may visibly increase).		ALL
1444 KIPLink + LARGE KEYBOARD	The unit is equipped with KIPLink, the innovative user interface based on WiFi technology, and, in addition, the physical LCD keyboard.		ALL
6194 LARGE KEYBOARD	The unit is equipped with the Large keyboard with a wide LCD display and led icons.		ALL
6195 7 INCH TOUCH SCREEN	The unit is equipped with the Touch interface, with a 7" WVGA colour display and a front USB port (WARNING: with outdoor temperature below 0°C the display response time may visibly increase).	The touch-screen's technology is characterized by an easy-to-access data, and it allows an effective graphical representation of the main figures protecting the access through 3 privilege levels.	ALL
6196 KIPLink	The unit is equipped with KIPLink, the innovative user interface based on WiFi technology		ALL
1570 POWER SOCKET			
1571 POWER SOCKET 230V MAX 500VA	230V power socket in the electrical board, CEE 7/3 type (Schuko). The maximum power available is 500VA.	It allows to supply power to small electric/electronic devices (lights, notebook, tablet, etc.) during maintenance operation.	ALL
3370 D - HYDRONIC MODULE			
3371 D - RELAY 1 PUMP (ON/OFF)	Desuperheater hydronic module. The unit is provided with 1 relay to control the activation of 1 external pump via single ON/OFF signal.	The hydronic module allows to control the external pumps with the unit controller logic. The partial heat recovery pumps are activated only when heat recovery is actually possible: compressors on, hot storage tank temperature lower than set-point and than compressor outlet gas temperature. The option minimizes pump consumption.	ALL

OPTIONS	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
1960 PRESSURE RELIEF VALVES			
1961 DUAL RELIEF VALVES WITH SWITCH	Dual relief valve with switch	Allows to unselect a relief valve in order to service the unit avoiding medium or long inoperative periods	ALL
2980 CONDENSER WATER CONN.			
2981 FLANGES CONDENSER CONNECTION			ALL
2982 FLEXIBLE JOINT CONDENSER CONN.			ALL
3430 REFRIGERANT LEAK DETECTOR			
3431 REFRIG. LEAK DETECTOR	Refrigerant leak detection system, supplied factory mounted and wired in the electrical board. In case of leak detection it will raise an alarm.	It promptly detects gas leakages	ALL
3432 REFRIG. LEAK DETECTOR+MIGR.	Refrigerant leak detection and migration system. In case the device detects a leakage the unit stops and stores the remaining refrigerant inside the evaporator, waiting for the intervention of a technician.	It promptly detects gas leakages, stops the unit and stores the remaining refrigerant.	ALL
2100 ANTIVIBRATION MOUNTING			
2101 RUBBER TYPE ANTIVIBR.MOUNTING			ALL
9970 PACKING			
9972 WOODEN BOX PACKING	Unit provided with wooden box		ALL
9973 WOODEN CAGE PACKING	Unit provided with wooden cage		ALL
9974 MARINE PACKING	Unit provided with barrier bag and wooden cage		ALL
9979 CONTAINER PACKING	Unit provided with container slides and covered with nylon		ALL
9995 METAL BARS, SUPPORTS AND NYLON	Unit provided with base metal bars, plastic supports and covered with nylon		ALL

5.2 Options - Additional information

1953 – HWT KIT

The accessory entails oversized compressor motor and is available only for standard version (8355) and /D version (8356).

491B – CD – 0-10V Signal (1 for circuit)

491C – CD – 0-10V Signal (1 for unit)

Maximum controller in/out connections length is 30m. Maximum controller in/out connections length is 30m.

6161 – Auxiliary signal 4-20mA

6162 – Remote signal double set point

These accessories provide for a maximum temperature difference of 15°C between the two set points, conditions being equal on the condenser side.

1511 - Unit with soft-start

The device has an effect on 2 phases and results in an oversized electrical panel. The accessory requires the use of automatic circuit breakers on the compressors (opt. 3412).

3301 – Compressor power factor correction

The device may require an oversized electrical panel.

1801 - Evaporator water flow switch

The accessory is supplied loose.

3431 – Refrigerant leak detector

3432 – Refrigerant leak detector + migration

For the proper functioning, compressors enclosure kit is mandatory (opt. 2301).

2631 – Double insulation on evaporator

19mm thickness of the insulation.

2301 – Compressor acoustical enclosure

Compressor enclosure is realized in peraluman panels with 30mm polyester acoustic insulation. The accessory leads to a noise reduction of 5 dB(A) (sound power level). This option entails an increase in the overall unit's dimensions.

33381 – 25% minimum compressor step

The accessory implies a reduction of the unit efficiency.

4864 - EV - VPF (w/o DP)(SU, MM_PR)

4865 - EV - VPF (w DP)(SU, MM_PR)

4866 - EV - VPF (M3000, CPRO, MM_N-PR)

With these accessories, the minimum leaving water temperature admitted is 5°C.

4867 - EV - VPF.D (SU, MM_PR)

4868 - EV - VPF.D(M3000, CPRO, MM_N-PR)


With these accessories, the minimum leaving water temperature admitted is 5°C..

3371 - D - Relay 1 pump (ON/OFF)

The operating diagram of the device is provided below:

Note: the thermostats T1, T2 and T3 are supplied cabled. It is the customer's responsibility to place the temperature probes in the storage tank.

The option leads to an extension of the lead time, contact our sales department for information

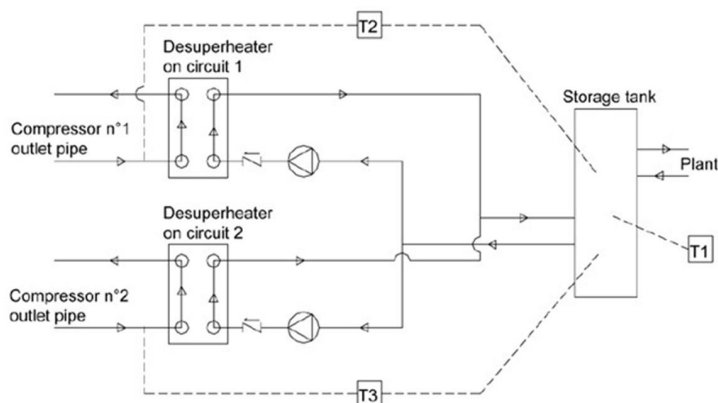

Operating diagram of the "partial heat recovery control" function for a unit with two refrigerant circuits.

1201 Cu/Ni 90/10 water condenser

The use of Cu/Ni 90/10 condenser will result in an increase of the condensing temperature. For the new performance calculation please contact our sales department.

C926108911 - KIT remote touch screen 7"

For remote touch screen user interface, the following electrical components are to be supplied by the customer:

- 24Vac or 24Vdc power supply for $I_{max}=1A$
- Serial cable 3x1 mm² shielded and twisted, max length 500m total.

A single W3000 touch keyboard can be used for more than one unit (up to a maximum of 8) in remote mode. In case of a multiple unit installation, maximum up to 8 units (of which maximum 6 units can be provided with +2P module) may be connected to one single remote touch screen keyboard only if the aforementioned units are provided with the same controller type and the same software version. For further information about multiple connections please refer to the Technical Manual of touch controller.

Chiller Plant Control with Active Optimization System

ClimaPRO System Manager

ClimaPRO System Manager represents the state-of-the-art platform for chiller plant management and control.

ClimaPRO ensures to actively optimize the entire chiller plant by managing and adjusting each component directly involved in the production and the distribution of the heating and the cooling energies, therefore involving chillers and heat pumps, pumping groups as well as the source-side devices like, for example, the cooling towers.

In particular, ClimaPRO measures in real-time all the operating variables from the field, for each individual device and each of the main system branche, by using serial communication lines as well as dedicated analogue signals.

The acquired data are then compared with the design data of each single unit at any different working conditions, thus allowing to implement control strategies based on dynamic algorithms which take into account the real operating conditions.

On the basis of these values, an advanced diagnostic module also allows to assess the level of efficiency for each individual unit, translating data into easy-to-read information in order to simplify and optimize the maintenance activities.

The "Chart Builder" software module allows to display the trends of the main operating variables. The "Reporting" module allows to send reports to selected users, including data and system's status of the main devices as well as to perform calculation of the energy indexes for each single unit and for the entire chiller plant.

The accessibility to ClimaPRO System Manager is ensured by an integrated web server that makes it visible from any computer equipped with a web browser, either locally or remotely.



6 GENERAL TECHNICAL DATA

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

FX-W-G05			0551	0651	0751	0851	0951	1102	1302	1402	1502	1602
Power supply			V/ph/Hz 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50									
PERFORMANCE												
COOLING ONLY (GROSS VALUE)												
Cooling capacity	(1)	kW	124,3	140,5	166,3	198,2	221,7	252,4	285,1	311,9	345,2	366,2
Total power input	(1)	kW	25,50	28,41	35,57	40,52	46,10	51,04	56,86	64,04	71,26	76,05
EER	(1)	kW/kW	4,875	4,947	4,671	4,894	4,809	4,949	5,011	4,873	4,842	4,812
COOLING ONLY (EN14511 VALUE)												
Cooling capacity	(1)(2)	kW	123,9	140,1	165,8	197,5	220,8	251,4	284,1	310,7	344,2	365,1
EER	(1)(2)	kW/kW	4,710	4,780	4,500	4,720	4,630	4,770	4,840	4,690	4,690	4,660
Cooling energy class			-	-	-	-	-	-	-	-	-	-
COOLING WITH PARTIAL RECOVERY												
Cooling capacity	(3)	kW	129,0	145,8	172,6	205,6	230,0	261,9	295,7	323,6	358,1	379,9
Total power input	(3)	kW	24,61	27,42	34,33	39,11	44,48	49,26	54,87	61,80	68,76	73,39
Desuperheater heating capacity	(3)	kW	11,02	12,27	15,37	17,51	19,91	22,05	24,57	27,67	30,78	32,86
COOLING WITH TOTAL HEAT RECOVERY												
Cooling capacity	(4)	kW	111,1	126,8	149,2	177,4	198,6	225,4	257,1	280,3	308,9	328,0
Total power input	(4)	kW	33,24	37,16	45,11	51,32	58,46	66,52	74,35	82,36	90,39	96,36
Recovery heat exchanger capacity	(4)	kW	142,4	161,8	191,6	225,6	253,5	287,9	327,0	357,7	393,8	418,6
EXCHANGERS												
HEAT EXCHANGER USER SIDE IN COOLING												
Water flow	(1)	l/s	5,944	6,719	7,954	9,479	10,60	12,07	13,63	14,91	16,51	17,51
Pressure drop at the heat exchanger	(1)	kPa	19,8	19,7	27,6	33,0	41,2	41,0	38,5	46,1	32,0	36,0
HEAT EXCHANGER SOURCE SIDE IN REFRIGERATION												
Water flow	(1)	l/s	7,133	8,045	9,611	11,37	12,75	14,45	16,29	17,90	19,83	21,06
Pressure drop at the heat exchanger	(1)	kPa	22,1	25,9	31,0	27,0	26,5	22,7	26,6	29,3	33,0	28,9
PARTIAL RECOVERY USER SIDE IN REFRIGERATION												
Water flow	(3)	l/s	0,532	0,592	0,742	0,845	0,961	1,064	1,186	1,336	1,486	1,586
Pressure drop at the heat exchanger	(3)	kPa	11,0	13,6	11,0	14,3	11,0	11,0	13,6	12,1	11,0	12,6
HEAT EXCHANGER RECOVERY USER SIDE IN REFRIGERATION												
Water flow	(4)	l/s	6,871	7,808	9,249	10,89	12,24	13,90	15,79	17,27	19,01	20,21
Pressure drop at the heat exchanger	(4)	kPa	20,5	24,4	28,7	24,7	24,5	21,0	25,0	27,2	30,3	26,6
REFRIGERANT CIRCUIT												
Compressors nr.		N°	1	1	1	1	1	2	2	2	2	2
Number of capacity steps		N°	0	0	0	0	0	0	0	0	0	0
No. Circuits		N°	1	1	1	1	1	2	2	2	2	2
Regulation			STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS STEPLESS									
Min. capacity step		%	25	25	25	25	25	25	25	25	25	25
Refrigerant			R513A R513A R513A R513A R513A R513A R513A R513A R513A R513A R513A									
Theoretical refrigerant charge		kg	23,1	33,6	31,5	58,8	56,7	46,2	67,2	65,1	63,0	90,3
Oil charge		kg	10,0	10,0	15,0	15,0	15,0	20,0	20,0	25,0	30,0	30,0
Rc (ASHRAE)	(5)	kg/kW	0,19	0,24	0,19	0,30	0,26	0,19	0,24	0,21	0,19	0,25
NOISE LEVEL												
Total sound Pressure	(6)	dB(A)	75	75	76	76	76	78	77	78	78	78
Total sound power level in cooling	(7)(8)	dB(A)	92	92	93	93	93	95	95	96	96	96
SIZE AND WEIGHT												
A	(9)	mm	2400	2600	2700	3000	3000	3000	3100	3100	3200	3200
B	(9)	mm	920	920	950	960	960	1100	1100	1100	1100	1200
H	(9)	mm	1500	1500	1500	1500	1500	1500	1500	1500	1600	1600
Operating weight	(9)	kg	1050	1110	1280	1450	1460	1710	1820	1990	2280	2430

Notes:

1 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger water (in/out) 30,00°C/35,00°C.

2 Values in compliance with EN14511

3 Plant (side) cooling exchanger water (in/out): 12,00°C/7,00°C; Source (side) heat exchanger water (in/out): 30,00°C/35,00°C; Plant (side) heat exchanger recovery water (in/out): 40,00°C/45,00°C.

4 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Plant (side) heat exchanger recovery water (in/out) 40,00°C/45,00°C.

5 Rated in accordance with AHRI Standard 550/590

6 Average sound pressure level at 1m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.

7 Sound power on the basis of measurements taken in compliance with ISO 9614.

8 Sound power level in cooling, indoors.

9 Unit in standard configuration, without optional accessories.

- Not available

Data certified in EUROVENT

GENERAL TECHNICAL DATA

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

FX-W-G05		1752	
Power supply		V/ph/Hz	400/3/50
PERFORMANCE			
COOLING ONLY (GROSS VALUE)			
Cooling capacity	(1)	kW	400,6
Total power input	(1)	kW	86,66
EER	(1)	kW/kW	4,621
COOLING ONLY (EN14511 VALUE)			
Cooling capacity	(1)(2)	kW	399,2
EER	(1)(2)	kW/kW	4,480
Cooling energy class			-
COOLING WITH PARTIAL RECOVERY			
Cooling capacity	(3)	kW	415,6
Total power input	(3)	kW	83,63
Desuperheater heating capacity	(3)	kW	37,44
COOLING WITH TOTAL HEAT RECOVERY			
Cooling capacity	(4)	kW	359,3
Total power input	(4)	kW	109,8
Recovery heat exchanger capacity	(4)	kW	462,5
EXCHANGERS			
HEAT EXCHANGER USER SIDE IN COOLING			
Water flow	(1)	l/s	19,16
Pressure drop at the heat exchanger	(1)	kPa	43,0
HEAT EXCHANGER SOURCE SIDE IN REFRIGERATION			
Water flow	(1)	l/s	23,19
Pressure drop at the heat exchanger	(1)	kPa	24,8
PARTIAL RECOVERY USER SIDE IN REFRIGERATION			
Water flow	(3)	l/s	1,807
Pressure drop at the heat exchanger	(3)	kPa	12,4
HEAT EXCHANGER RECOVERY USER SIDE IN REFRIGERATION			
Water flow	(4)	l/s	22,32
Pressure drop at the heat exchanger	(4)	kPa	23,0
REFRIGERANT CIRCUIT			
Compressors nr.		N°	2
Number of capacity steps		N°	0
No. Circuits		N°	2
Regulation		STEPLESS	
Min. capacity step		%	25
Refrigerant		R513A	
Theoretical refrigerant charge		kg	116
Oil charge		kg	30,0
Rc (ASHRAE)	(5)	kg/kW	0,29
NOISE LEVEL			
Total sound Pressure	(6)	dB(A)	78
Total sound power level in cooling	(7)(8)	dB(A)	96
SIZE AND WEIGHT			
A	(9)	mm	3200
B	(9)	mm	1200
H	(9)	mm	1600
Operating weight	(9)	kg	2590

Notes:

1 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger water (in/out) 30,00°C/35,00°C.

2 Values in compliance with EN14511

3 Plant (side) cooling exchanger water (in/out): 12,00°C/7,00°C; Source (side) heat exchanger water (in/out): 30,00°C/35,00°C; Plant (side) heat exchanger recovery water (in/out): 40,00°C/45,00°C.

4 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Plant (side) heat exchanger recovery water (in/out) 40,00°C/45,00°C.

5 Rated in accordance with AHRI Standard 550/590

6 Average sound pressure level at 1m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.

7 Sound power on the basis of measurements taken in compliance with ISO 9614.

8 Sound power level in cooling, indoors.

9 Unit in standard configuration, without optional accessories.

- Not available

Data certified in EUROVENT

7 TECHNICAL DATA SEASONAL EFFICIENCY IN COOLING (EN14825 VALUE)

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

ENERGY EFFICIENCY

SEASONAL EFFICIENCY IN COOLING (Reg. EU 2016/2281)

Ambient refrigeration

FX-W-G05			0551	0651	0751	0851	0951	1102	1302	1402	1502	1602
Prated,c	(1)	kW	123,9	140,1	165,8	197,5	220,8	251,4	284,1	310,7	344,2	365,1
SEER	(1) (2)	-	5,37	5,37	5,36	5,40	5,35	5,64	5,62	5,58	5,61	5,61
Performance η_s	(1) (3)	%	212,0	212,0	211,0	213,0	211,0	223,0	222,0	220,0	221,0	222,0
FX-W-G05			1752									
Prated,c	(1)	kW	399,2									
SEER	(1) (2)	-	5,57									
Performance η_s	(1) (3)	%	220,0									

Notes:

(1) Parameter calculated according to [REGULATION (EU) N. 2016/2281]

(2) Seasonal energy efficiency ratio

(3) Seasonal space cooling energy efficiency


The units highlighted in this publication contain R513A [GWP₁₀₀ 572] fluorinated greenhouse gases.

Data certified in EUROVENT

8 OPERATING LIMITS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

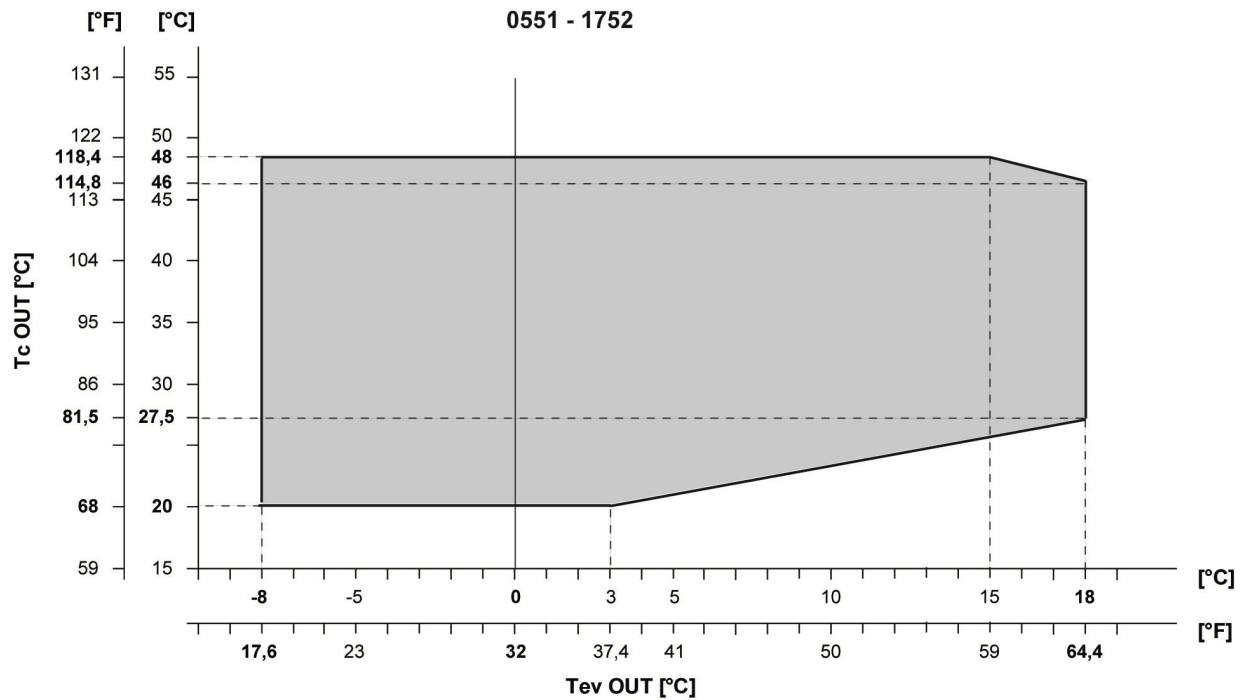

Tc out Source (side) heat exchanger water

Tev out Plant (side) cooling exchanger water

For the limits of single size and version refer to software ELCA.

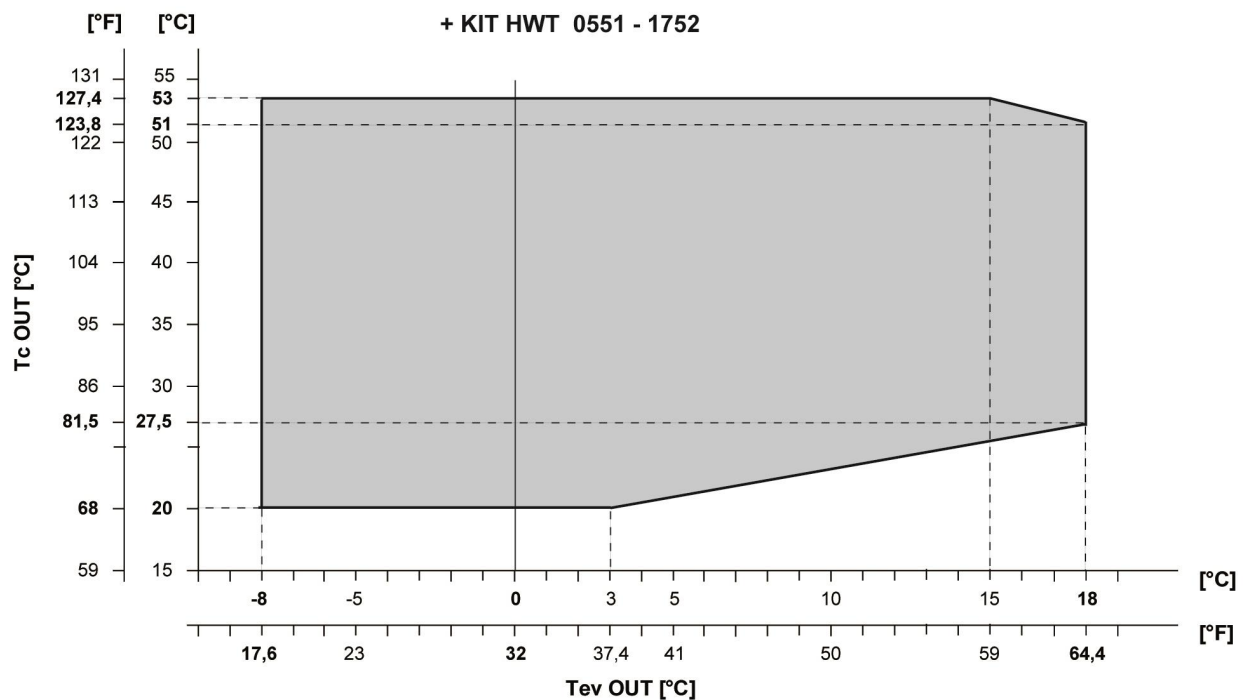

Tc out Source (side) heat exchanger water

Tev out Plant (side) cooling exchanger water

For the limits of single size and version refer to software ELCA.

OPERATING LIMITS**Data Book**

FX-W-G05 0551 - 1752_202109_EN R513A

SIZE
FX-W-G05 /0551
FX-W-G05 /0651
FX-W-G05 /0751
FX-W-G05 /0851
FX-W-G05 /0951
FX-W-G05 /1102
FX-W-G05 /1302
FX-W-G05 /1402
FX-W-G05 /1502
FX-W-G05 /1602
FX-W-G05 /1752
FX-W-G05 /D /0551
FX-W-G05 /D /0651
FX-W-G05 /D /0751
FX-W-G05 /D /0851
FX-W-G05 /D /0951
FX-W-G05 /D /1102
FX-W-G05 /D /1302
FX-W-G05 /D /1402
FX-W-G05 /D /1502
FX-W-G05 /D /1602
FX-W-G05 /D /1752
FX-W-G05 /R /0551
FX-W-G05 /R /0651
FX-W-G05 /R /0751
FX-W-G05 /R /0851
FX-W-G05 /R /0951
FX-W-G05 /R /1102
FX-W-G05 /R /1302
FX-W-G05 /R /1402
FX-W-G05 /R /1502
FX-W-G05 /R /1602
FX-W-G05 /R /1752

OPERATING LIMITS

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

8.2 ETHYLENE GLYCOL MIXTURE

Ethylene glycol and water mixture, used as a heat-conveying fluid, cause a variation in unit performance. For correct data, use the factors indicated in the following tabel.

	Freezing point (°C)							
	0	-5	-10	-15	-20	-25	-30	-35
	Ethylene glycol percentage by weight							
	0%	12%	20%	30%	35%	40%	45%	50%
cPf	1	0,985	0,98	0,974	0,97	0,965	0,964	0,96
cQ	1	1,02	1,04	1,075	1,11	1,14	1,17	1,2
cdp	1	1,07	1,11	1,18	1,22	1,24	1,27	1,3

cPf: cooling power correction factor

cQ: flow correction factor

cdp: pressure drop correction factor

For data concerning other kind of anti-freeze solutions (e.g, propylene glycol) please contact our Sale Department.

8.3 FOULING FACTORS

Performances are based on clean condition of tubes (fouling factor = 1). For different fouling values, performance should be adjusted using the correction factors shown in the following table.

SERIES	FOULING FACTORS	EVAPORATOR			CONDENSER/RECOVERY			DESUPERHEATER
	ff (m ² °CW)	F1	FK1	KE [°C]	F2	FK2	KC [°C]	R3
VARIOUS	0	1,000	1,000	0,0	1,000	1,000	0,0	1,000
VARIOUS	1,80 x 10 ⁻⁵	1,000	1,000	0,0	1,000	1,000	0,0	1,000
VARIOUS	4,40 x 10 ⁻⁵	1,000	1,000	0,0	0,990	1,030	1,0	0,990
VARIOUS	8,80 x 10 ⁻⁵	0,960	0,990	0,7	0,980	1,040	1,5	0,980
VARIOUS	13,20 x 10 ⁻⁵	0,944	0,985	1,0	0,964	1,050	2,3	0,964
VARIOUS	17,20 x 10 ⁻⁵	0,930	0,980	1,5	0,950	1,060	3,0	0,950

ff: fouling factors

F1 - F2: potential correction factors

FK1 - FK2: compressor power input correction factors

R3: capacity correction factors

KE: minimum evaporator outlet temperature increase

KC: maximum condenser outlet temperature decrease

9 HYDRAULIC DATA

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

Water flow and pressure drop

Water flow in the plant (side) exchanger is given by:

$$Q = P / (4,186 \times \Delta T)$$

Q: water flow (l/s)

 ΔT : difference between inlet and outlet water temp. (°C)

P: heat exchanger capacity (kW)

Pressure drop is given by:

$$\Delta p = K \times (3,6 \times Q)^2 / 1000$$

Q: water flow (l/s)

 Δp : pressure drop (kPa)

K: unit size ratio

SIZE	Power supply V/ph/Hz	HEAT EXCHANGER USER SIDE					HEAT EXCHANGER SOURCE SIDE				HEAT RECOVERY EX. USER SIDE			
		K	Q min l/s	Q max l/s	C.A.S. l	C.a. min l	K [1]	Q min [2] l/s	Q max l/s	C.A.S. l	K	Q min l/s	Q max l/s	C.A.S. l
FX-W-G05 /0551	400/3/50	43,3	4,417	20,47	67,7	620	33,5	2,122	12,22	21,9	-	-	-	-
FX-W-G05 /0651	400/3/50	33,7	4,417	20,47	61,8	700	30,9	2,333	13,44	26,3	-	-	-	-
FX-W-G05 /0751	400/3/50	33,7	4,417	20,47	61,8	830	25,9	2,544	14,67	28,7	-	-	-	-
FX-W-G05 /0851	400/3/50	28,3	6,389	14,72	90,0	990	16,1	3,194	18,33	35,8	-	-	-	-
FX-W-G05 /0951	400/3/50	28,3	6,389	14,72	90,0	1110	12,6	3,611	20,78	40,6	-	-	-	-
FX-W-G05 /1102	400/3/50	21,7	7,222	16,67	85,0	880	8,38	4,250	24,44	43,8	-	-	-	-
FX-W-G05 /1302	400/3/50	16,0	8,333	19,44	80,0	1000	7,74	4,667	26,89	52,6	-	-	-	-
FX-W-G05 /1402	400/3/50	16,0	8,333	19,44	80,0	1090	7,05	4,889	28,11	55,0	-	-	-	-
FX-W-G05 /1502	400/3/50	9,05	9,167	26,94	116	1210	6,47	5,083	29,33	57,4	-	-	-	-
FX-W-G05 /1602	400/3/50	9,05	9,167	26,94	116	1280	5,03	5,722	33,00	64,5	-	-	-	-
FX-W-G05 /1752	400/3/50	9,05	9,167	26,94	116	1400	3,56	6,778	39,11	76,4	-	-	-	-
FX-W-G05 /D /0551	400/3/50	43,3	4,417	20,47	67,7	620	33,5	2,122	12,22	21,9	2990	-	1,583	2,80
FX-W-G05 /D /0651	400/3/50	33,7	4,417	20,47	61,8	700	30,9	2,333	13,44	26,3	2990	-	1,583	2,80
FX-W-G05 /D /0751	400/3/50	33,7	4,417	20,47	61,8	830	25,9	2,544	14,67	28,7	1542	-	2,222	3,40
FX-W-G05 /D /0851	400/3/50	28,3	6,389	14,72	90,0	990	16,1	3,194	18,33	35,8	1542	-	2,222	3,40
FX-W-G05 /D /0951	400/3/50	28,3	6,389	14,72	90,0	1110	12,6	3,611	20,78	40,6	920	-	2,861	4,00
FX-W-G05 /D /1102	400/3/50	21,7	7,222	16,67	85,0	880	8,38	4,250	24,44	43,8	748	-	3,167	5,60
FX-W-G05 /D /1302	400/3/50	16,0	8,333	19,44	80,0	1000	7,74	4,667	26,89	52,6	748	-	3,167	5,60
FX-W-G05 /D /1402	400/3/50	16,0	8,333	19,44	80,0	1090	7,05	4,889	28,11	55,0	522	-	3,806	6,20
FX-W-G05 /D /1502	400/3/50	9,05	9,167	26,94	116	1210	6,47	5,083	29,33	57,4	386	-	4,444	6,80
FX-W-G05 /D /1602	400/3/50	9,05	9,167	26,94	116	1280	5,03	5,722	33,00	64,5	386	-	4,444	6,80
FX-W-G05 /D /1752	400/3/50	9,05	9,167	26,94	116	1400	3,56	6,778	39,11	76,4	293	-	5,083	7,40
FX-W-G05 /R /0551	400/3/50	43,3	4,417	20,47	67,7	620	33,5	4,250	12,22	21,9	33,5	4,250	12,22	21,9
FX-W-G05 /R /0651	400/3/50	33,7	4,417	20,47	61,8	700	30,9	4,667	13,44	26,3	30,9	4,667	13,44	26,3
FX-W-G05 /R /0751	400/3/50	33,7	4,417	20,47	61,8	830	25,9	5,083	14,67	28,7	25,9	5,083	14,67	28,7
FX-W-G05 /R /0851	400/3/50	28,3	6,389	14,72	90,0	990	16,1	6,361	18,33	35,8	16,1	6,361	18,33	35,8
FX-W-G05 /R /0951	400/3/50	28,3	6,389	14,72	90,0	1110	12,6	7,222	20,78	40,6	12,6	7,222	20,78	40,6
FX-W-G05 /R /1102	400/3/50	21,7	7,222	16,67	85,0	880	8,38	8,472	24,44	43,8	8,38	8,472	24,44	43,8
FX-W-G05 /R /1302	400/3/50	16,0	8,333	19,44	80,0	1000	7,74	9,333	26,89	52,6	7,74	9,333	26,89	52,6
FX-W-G05 /R /1402	400/3/50	16,0	8,333	19,44	80,0	1090	7,05	9,750	28,11	55,0	7,05	9,750	28,11	55,0
FX-W-G05 /R /1502	400/3/50	9,05	9,167	26,94	116	1210	6,47	10,17	29,33	57,4	6,47	10,17	29,33	57,4
FX-W-G05 /R /1602	400/3/50	9,05	9,167	26,94	116	1280	5,03	11,44	33,00	64,5	5,03	11,44	33,00	64,5
FX-W-G05 /R /1752	400/3/50	9,05	9,167	26,94	116	1400	3,56	13,58	39,11	76,4	3,56	13,58	39,11	76,4

The coefficient "K" on the source side heat exchanger is referred to its standart selection. When it's required to move to an higher number of steps water side (with $\Delta T > 10^\circ\text{C}$), "K" coefficient as to be multiplied for 8,5 (Knew = K x 8,5)

Q min: minimum water flow admitted to the heat exchanger

Q min [2]: minimum water flow admitted to the heat exchanger

Q max: maximum water flow admitted to the heat exchanger

C.a. min: minimum water content admitted in the plant

C.A.S.: Exchanger water content

10 ELECTRICAL DATA

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

10.1 ELECTRIC DATA

[SI System]

FX-W-G05

SIZE	Power supply V/ph/Hz	Maximum values						
		Compressor				Total (1)		
		n	F.L.I. [kW]	F.L.A. [A]	L.R.A. [A]	F.L.I. [kW]	F.L.A. [A]	S.A. [A]
0551	400/3/50	1	1x38.3	1x63.8	1x169	38,30	64	169
0651	400/3/50	1	1x43.2	1x72.1	1x218	43,00	72	218
0751	400/3/50	1	1x50.9	1x84.4	1x267	51,00	84	267
0851	400/3/50	1	1x58.2	1x95.7	1x290	58,00	96	290
0951	400/3/50	1	1x66.3	1x109.2	1x350	66,00	109	350
1102	400/3/50	2	2x38.3	2x63.8	2x169	77,00	128	211
1302	400/3/50	2	2x43.2	2x72.1	2x218	86,00	144	265
1402	400/3/50	2	1x43.2+1x50.9	1x72.1+1x84.4	1x218+1x267	94,00	157	314
1502	400/3/50	2	2x50.9	2x84.4	2x267	102,0	169	326
1602	400/3/50	2	1x50.9+1x58.2	1x84.4+1x95.7	1x267+1x290	109,0	180	349
1752	400/3/50	2	1x58.2+1x66.3	1x95.7+1x109.2	1x290+1x350	125,0	205	415

F.L.I.: Full load power

F.L.A.: Full load current

L.R.A.: Locked rotor amperes for single compressor

S.A.: Inrush current

(1) Safety values to be considered when cabling the unit for power supply and line-protections

Data valid for standard units without any additional option.

Voltage tolerance: 10%

Maximum voltage unbalance: 2%

Given the typical operating conditions of units designed for indoor installation, which can be associated (according to reference document IEC 60721) to the following classes:

- climatic conditions class AA4: air temperature range from 5 up to 42°C (*)
- special climatic conditions negligible
- presence of water class AD2: possibility of water dripping inside the technical room
- biological conditions class 4B1 and 4C2: negligible presence of corrosive and polluting substances
- mechanically active substances class 4S2: locations in areas with sand or dust sources

The required protection level for safe operation, according to reference document IEC 60529, is IP21 BW (protection against access of external devices with diameter larger than 12 mm and water falling vertically).

The unit can be considered IP21 CW protected, thus fulfilling the above operating conditions.

(*) for the unit's operating limits, see "selection limits" section

11 FULL LOAD SOUND LEVEL

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

FX-W-G05

SOUND POWER LEVEL IN COOLING									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound power level dB								
0551	70	73	88	87	89	84	78	67	92
0651	70	73	88	87	89	84	78	67	92
0751	71	74	89	88	90	85	79	68	93
0851	71	74	89	88	90	85	79	68	93
0951	71	74	89	88	90	85	79	68	93
1102	73	76	91	90	92	87	81	71	95
1302	73	76	91	90	92	87	81	71	95
1402	74	77	92	91	93	88	82	72	96
1502	74	77	92	91	93	88	82	72	96
1602	74	77	92	91	93	88	82	72	96
1752	74	77	92	91	93	88	82	72	96

Working conditions

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger water (in/out) 30,00°C/35,00°C.

Sound power on the basis of measurements taken in compliance with ISO 9614.

Such certification refers specifically to the sound Power Level in dB(A). This is therefore the only acoustic data to be considered as binding.

Sound power level in cooling, indoors.


FX-W-G05

SOUND PRESSURE LEVEL									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound pressure level dB								
0551	53	56	71	70	72	67	61	50	75
0651	53	56	71	70	72	67	61	50	75
0751	54	57	72	71	73	68	62	51	76
0851	54	57	72	71	73	68	62	51	76
0951	54	57	72	71	73	68	62	51	76
1102	56	59	74	73	75	70	64	54	78
1302	55	58	73	72	74	69	63	53	77
1402	56	59	74	73	75	70	64	54	78
1502	56	59	74	73	75	70	64	54	78
1602	56	59	74	73	75	70	64	54	78
1752	56	59	74	73	75	70	64	54	78


Working conditions

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger water (in/out) 30,00°C/35,00°C.

Average sound pressure level at 1m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.

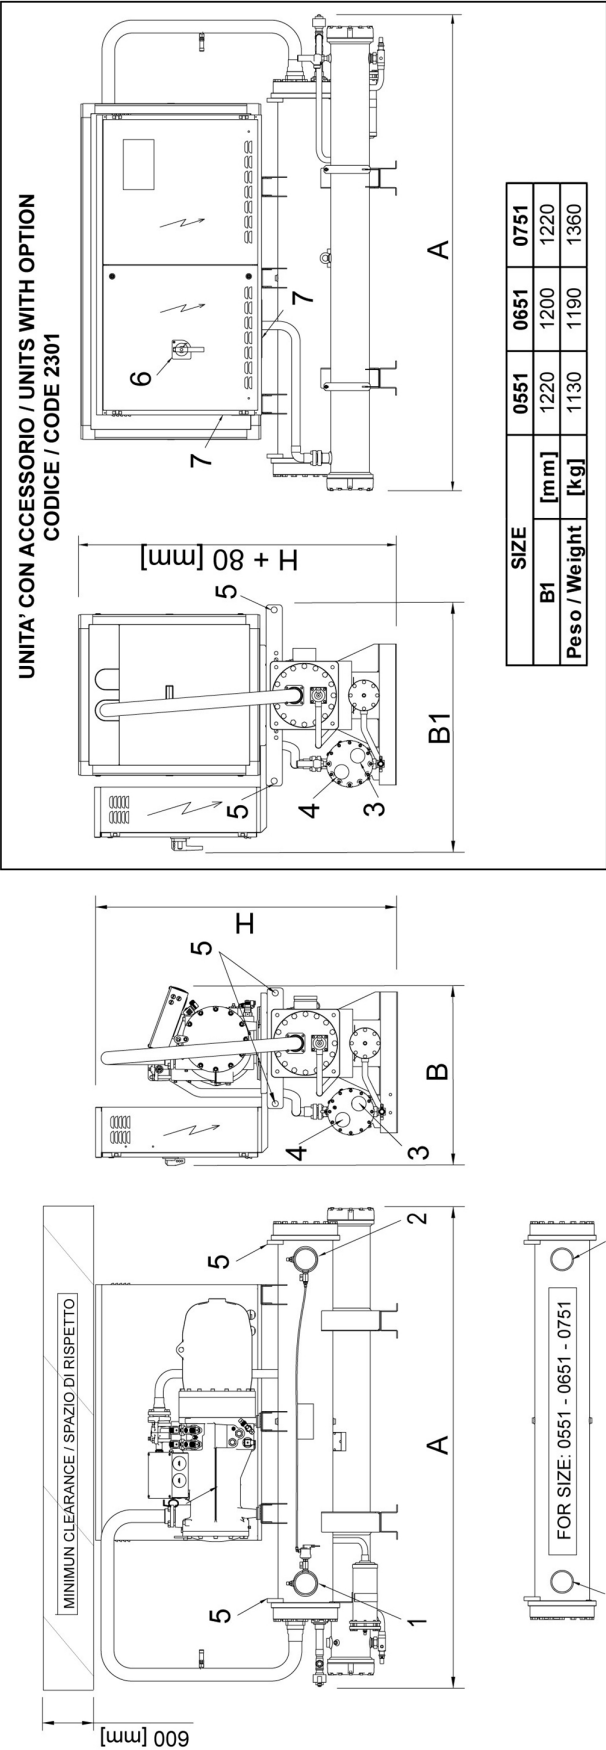

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 6 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 7 - POWER INLET
INGRESSO LINEA ELETTRICA

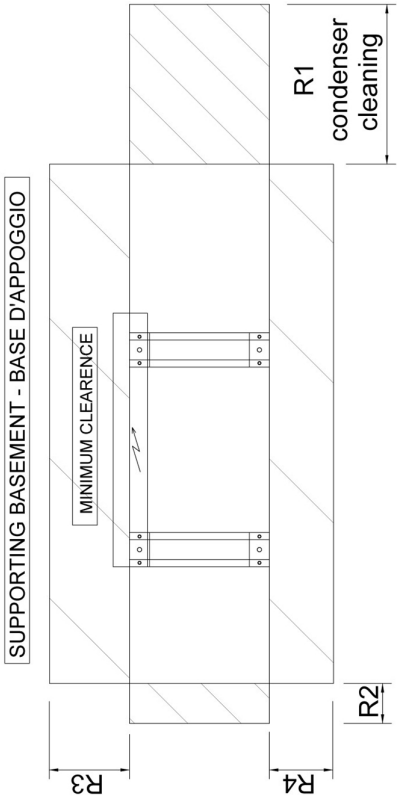

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]


SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /0551	2400	920	1500	1050	2000	500	1000	800	H	4"	E1	2" 1/2	-	-
FX-W-G05 /0651	2600	920	1500	1110	2000	500	1000	800	H	4"	E1	2" 1/2	-	-
FX-W-G05 /0751	2700	950	1500	1280	2000	500	1000	800	H	4"	E1	2" 1/2	-	-

DIMENSIONAL DRAWINGS

Data Book
FX-W-G05 0551 - 1752_202109_EN R513A

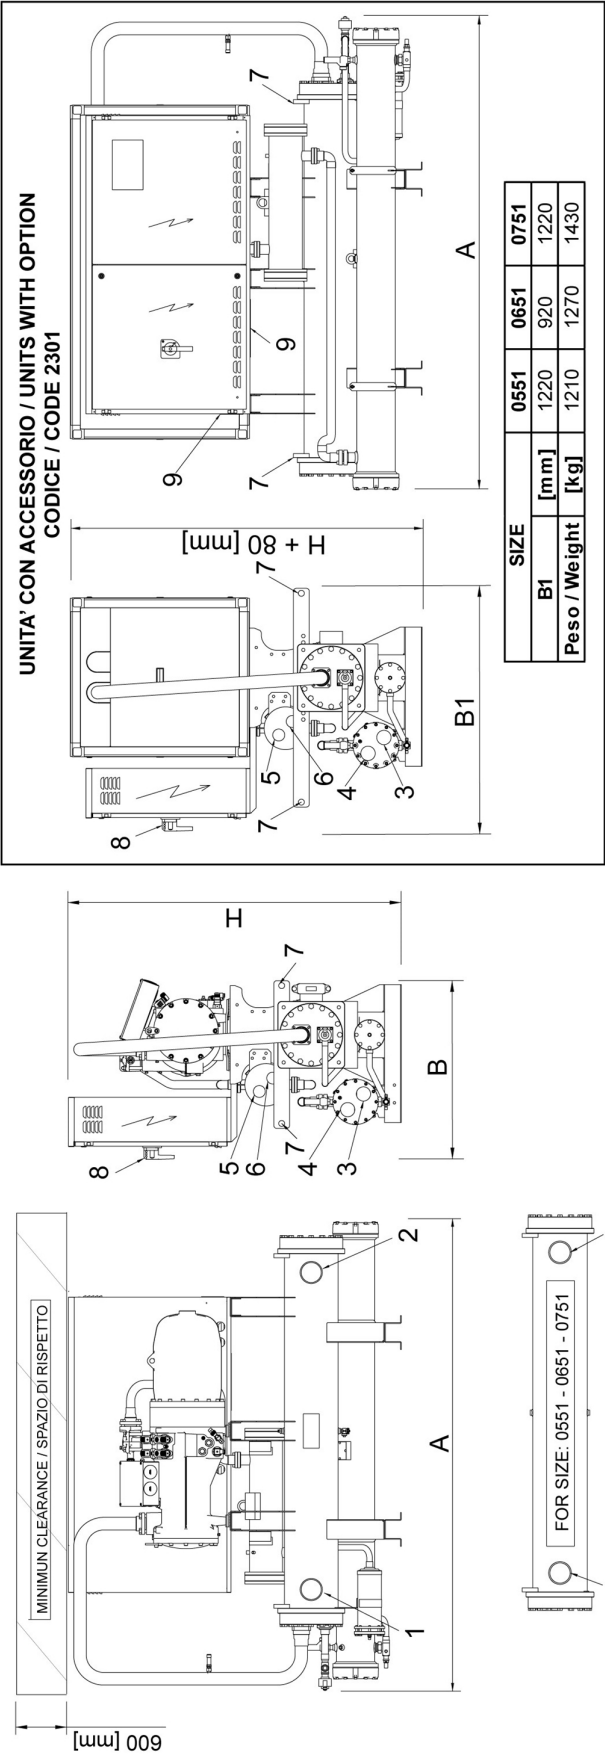

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - DESUPERHEATER WATER INLET
ENTRATA ACQUA DESURRISCALDATORE
- 6 - DESUPERHEATER WATER OUTLET
USCITA ACQUA DESURRISCALDATORE
- 7 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 8 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 9 - POWER INLET
INGRESSO LINEA ELETTRICA

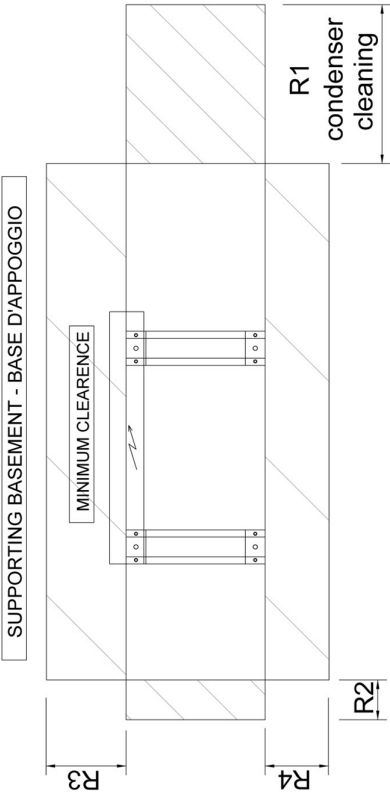

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]


SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /D /0551	2400	920	1690	1120	2000	500	1000	800	H	4"	E1	2" 1/2	E1	2"
FX-W-G05 /D /0651	2600	920	1690	1180	2000	500	1000	800	H	4"	E1	2" 1/2	E1	2"
FX-W-G05 /D /0751	2700	950	1690	1350	2000	500	1000	800	H	4"	E1	2" 1/2	E1	2"

DIMENSIONAL DRAWINGS

Data Book
FX-W-G05 0551 - 1752_202109_EN R513A

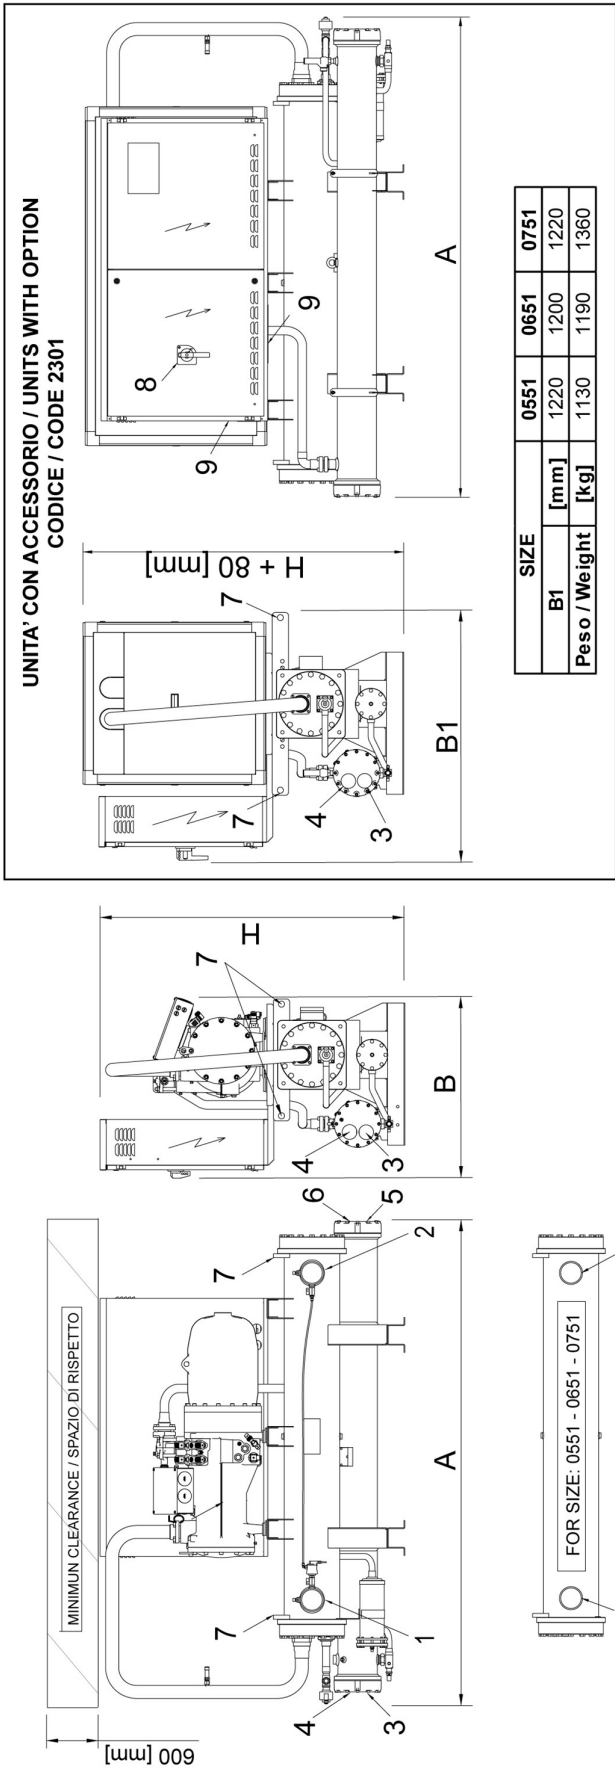

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - HEAT RECOVERY WATER INLET
ENTRATA ACQUA RECUPERATORE
- 6 - HEAT RECOVERY WATER OUTLET
USCITA ACQUA RECUPERATORE
- 7 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 8 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 9 - POWER INLET
INGRESSO LINEA ELETTRICA

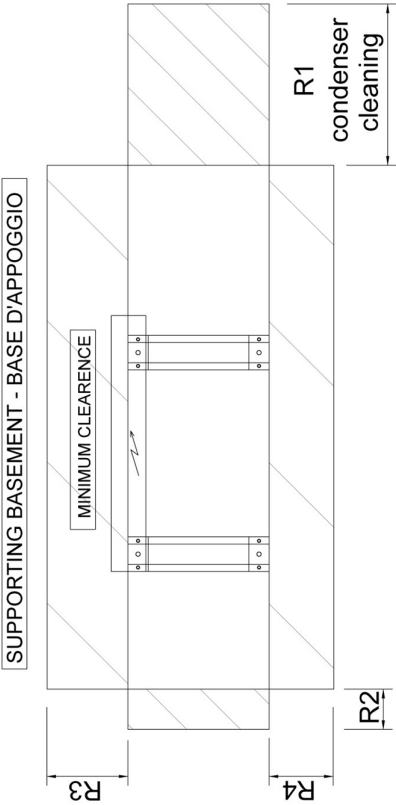

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]


SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /R /0551	2400	920	1650	1218	2000	500	1000	800	H	4"	E1	2" 1/2	[E1] - Attacco filet	2" 1/2
FX-W-G05 /R /0651	2600	920	1650	1276	2000	500	1000	800	H	4"	E1	2" 1/2	[E1] - Attacco filet	2" 1/2
FX-W-G05 /R /0751	2700	950	1650	1560	2000	500	1000	800	H	4"	E1	3"	[E1] - Attacco filet	3"

DIMENSIONAL DRAWINGS

Data Book
FX-W-G05 0551 - 1752_202109_EN R513A

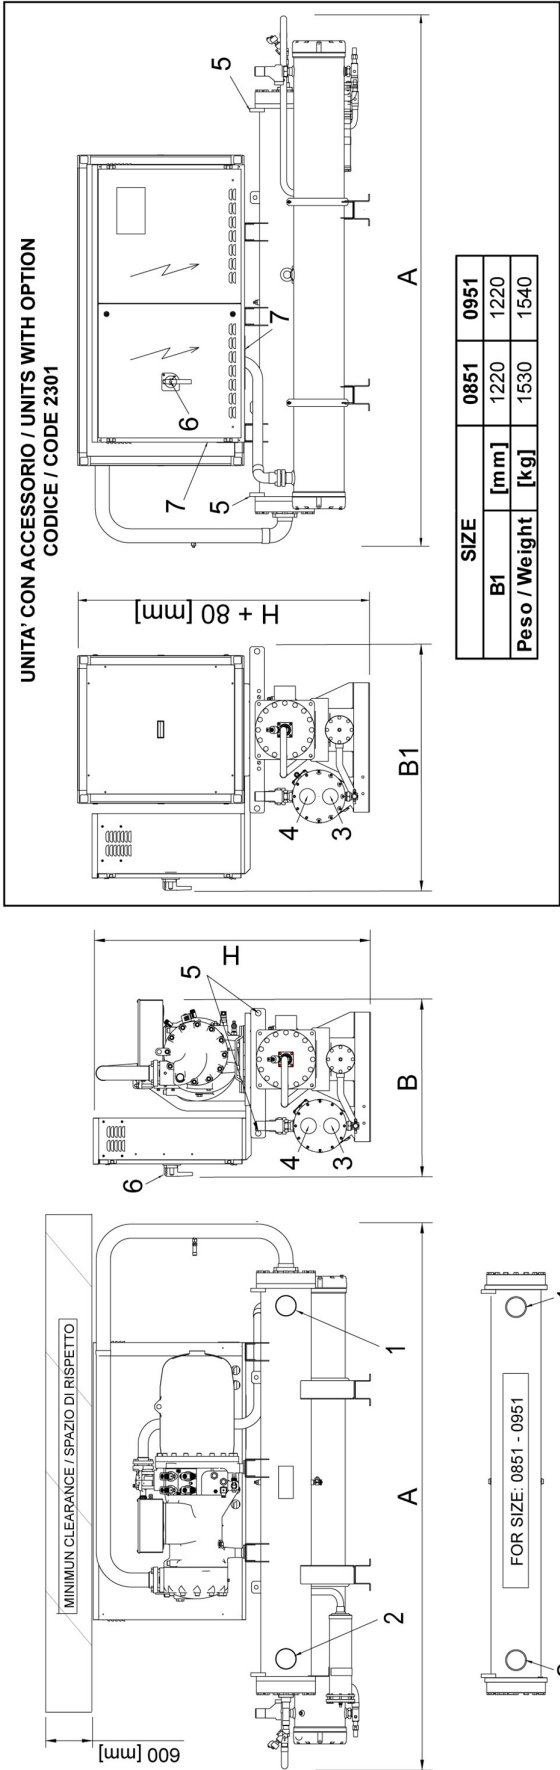

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 6 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 7 - POWER INLET
INGRESSO LINEA ELETTRICA

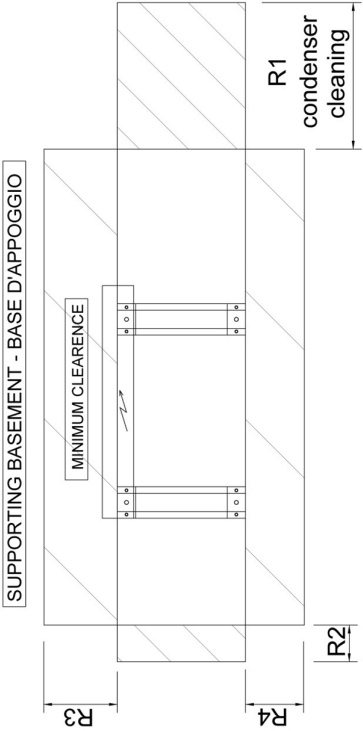

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]


SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /0851	3000	960	1500	1450	2000	500	1000	800	H	4"	E1	3"	-	-
FX-W-G05 /0951	3000	960	1500	1460	2000	500	1000	800	H	4"	E1	3"	-	-

DIMENSIONAL DRAWINGS

Data Book
FX-W-G05 0551 - 1752_202109_EN R513A

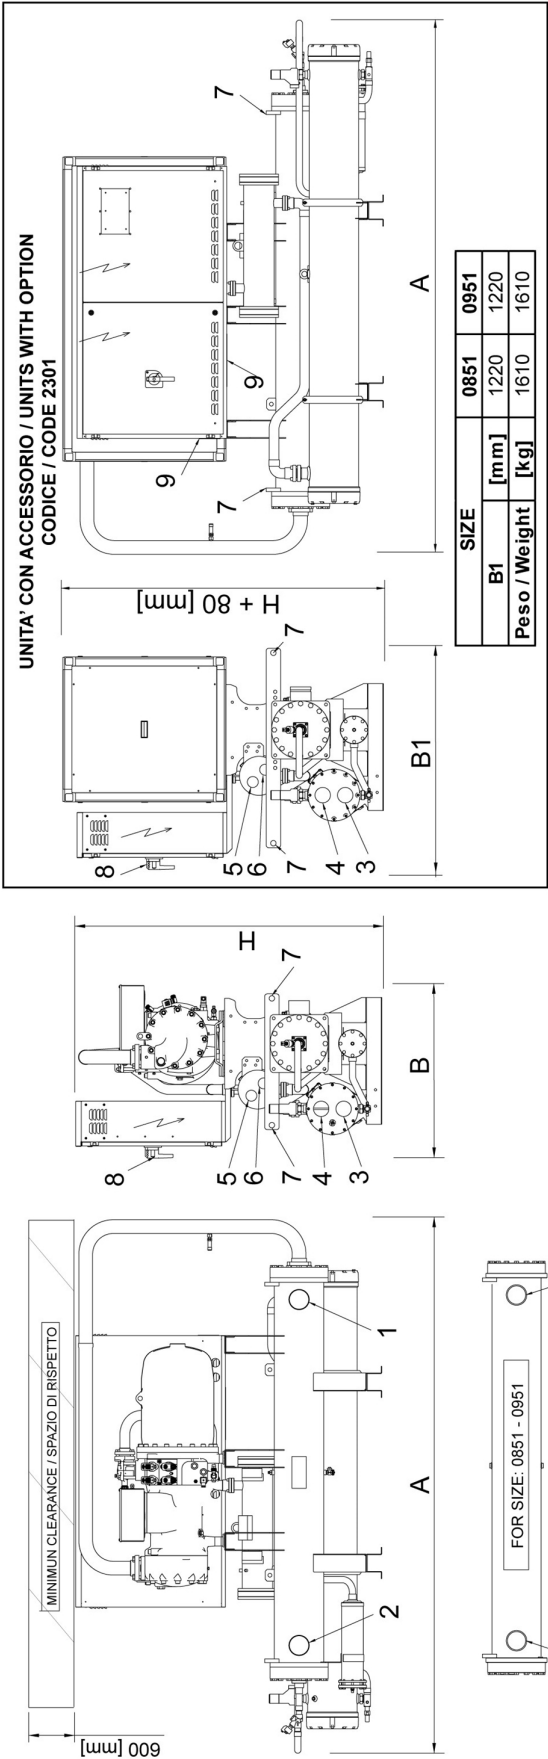

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - DESUPERHEATER WATER INLET
ENTRATA ACQUA DESURRISCALDATORE
- 6 - DESUPERHEATER WATER OUTLET
USCITA ACQUA DESURRISCALDATORE
- 7 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 8 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 9 - POWER INLET
INGRESSO LINEA ELETTRICA

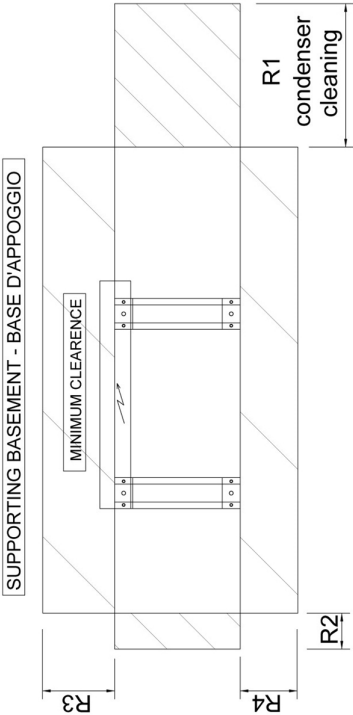

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.




DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /D /0851	3000	960	1690	1520	2000	500	1000	800	H	4"	E1	3"	E1	2"
FX-W-G05 /D /0951	3000	960	1690	1530	2000	500	1000	800	H	4"	E1	3"	E1	2"

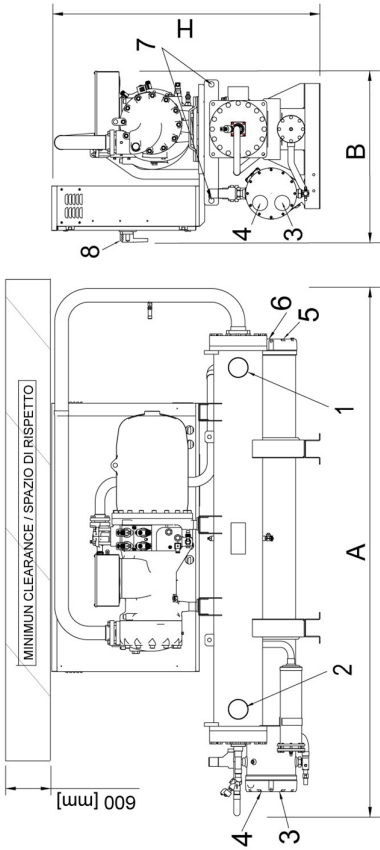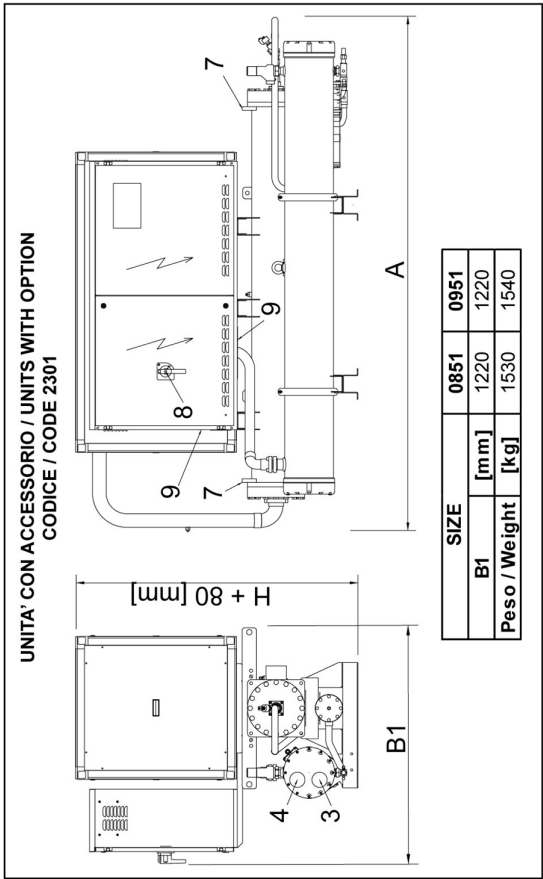

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - HEAT RECOVERY WATER INLET
ENTRATA ACQUA RECUPERATORE
- 6 - HEAT RECOVERY WATER OUTLET
USCITA ACQUA RECUPERATORE
- 7 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 8 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 9 - POWER INLET
INGRESSO LINEA ELETTRICA

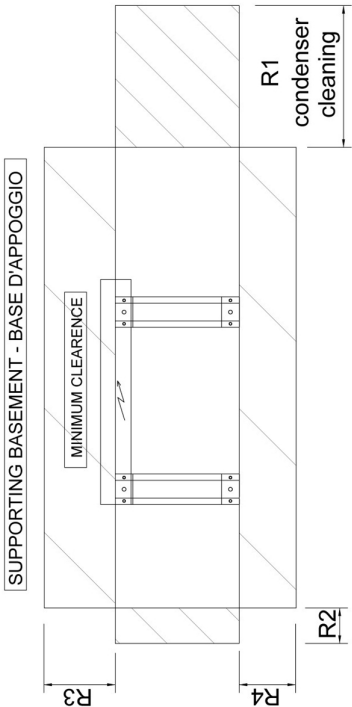

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.


DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /R /0851	3000	960	1650	1656	2000	500	1000	800	H	4"	E1	3"	[E1] - Attacco filet	3"
FX-W-G05 /R /0951	3000	960	1650	1774	2000	500	1000	800	H	4"	E1	3"	[E1] - Attacco filet	3"

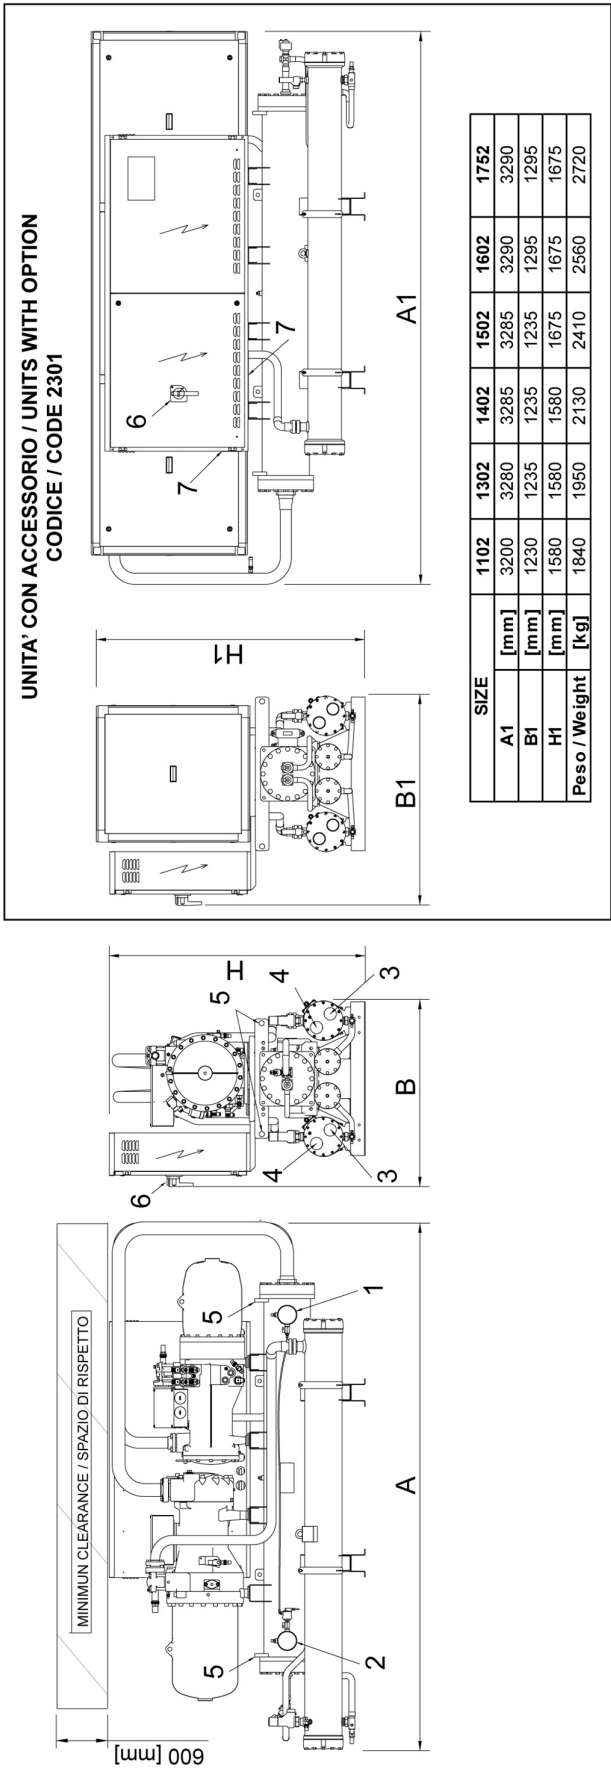

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 6 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 7 - POWER INLET
INGRESSO LINEA ELETTRICA

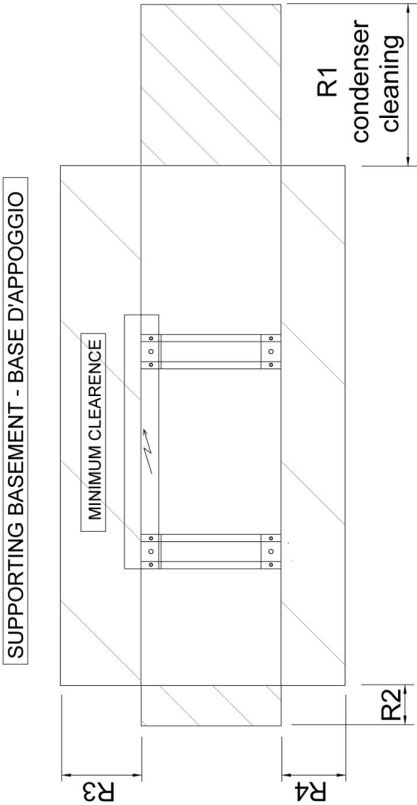

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

Data Book



FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]


SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /1102	3000	1100	1500	1710	2000	500	1000	800	H	4"	E1	2" 1/2	-	-
FX-W-G05 /1302	3100	1100	1500	1820	2000	500	1000	800	H	4"	E1	2" 1/2	-	-
FX-W-G05 /1402	3100	1100	1500	1990	2000	500	1000	800	H	4"	E1	2" 1/2	-	-
FX-W-G05 /1502	3200	1100	1600	2280	2000	500	1000	800	H	5"	E1	2" 1/2	-	-
FX-W-G05 /1602	3200	1200	1600	2430	2000	500	1000	800	H	5"	E1	2" 1/2	-	-
FX-W-G05 /1752	3200	1200	1600	2590	2000	500	1000	800	H	5"	E1	2" 1/2 3"	-	-

DIMENSIONAL DRAWINGS

Data Book
FX-W-G05 0551 - 1752_202109_EN R513A

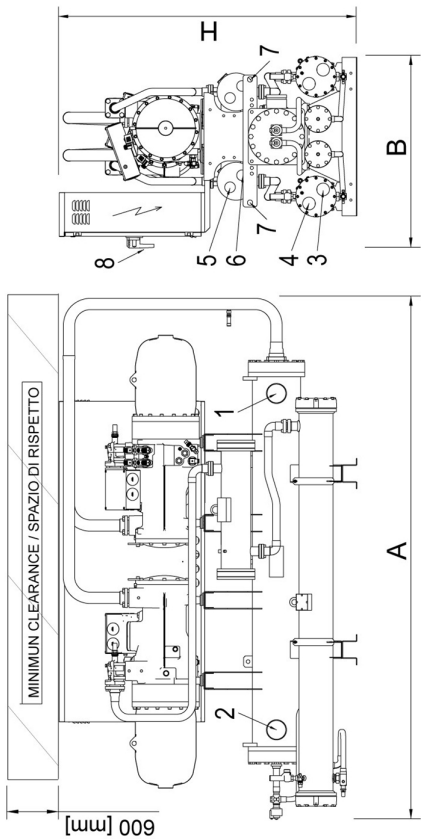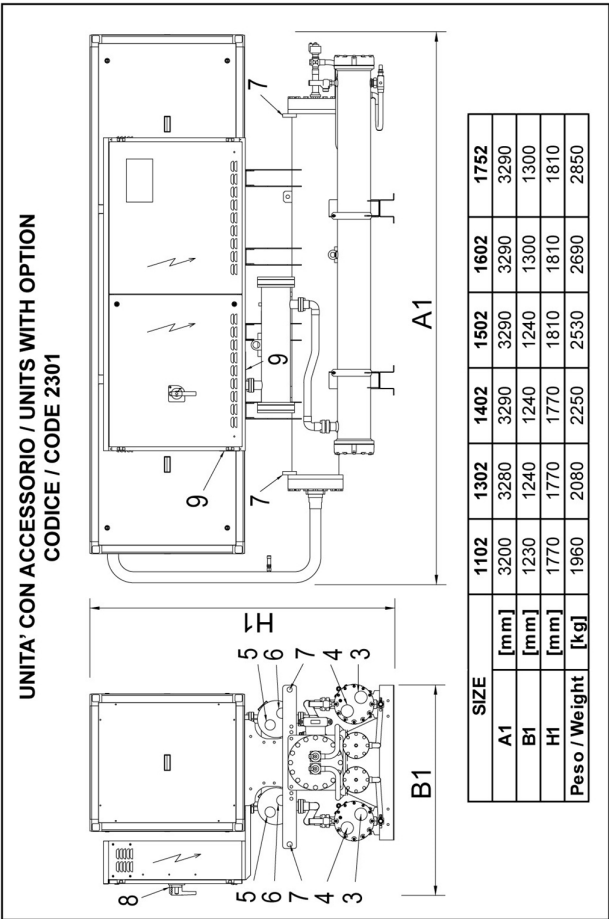

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE
- 2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE
- 3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE
- 4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE
- 5 - DESUPERHEATER WATER INLET
ENTRATA ACQUA DESURRISCALDATORE
- 6 - DESUPERHEATER WATER OUTLET
USCITA ACQUA DESURRISCALDATORE
- 7 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO
- 8 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE
- 9 - POWER INLET
INGRESSO LINEA ELETTRICA

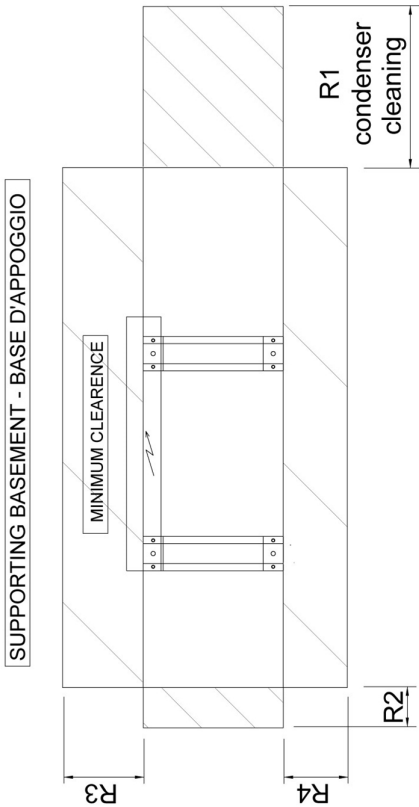

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

Data Book


FX-W-G05 0551 - 1752_202109_EN R513A

[SI System]

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /D /1102	3000	1100	1690	1830	2000	500	1000	800	H	4"	E1	2" 1/2	E1	2"
FX-W-G05 /D /1302	3100	1100	1690	1940	2000	500	1000	800	H	4"	E1	2" 1/2	E1	2"
FX-W-G05 /D /1402	3100	1100	1690	2110	2000	500	1000	800	H	4"	E1	2" 1/2	E1	2"
FX-W-G05 /D /1502	3200	1100	1725	2390	2000	500	1000	800	H	5"	E1	2" 1/2	E1	2"
FX-W-G05 /D /1602	3200	1200	1725	2550	2000	500	1000	800	H	5"	E1	2" 1/2	E1	2"
FX-W-G05 /D /1752	3200	1200	1725	2710	2000	500	1000	800	H	5"	E1	2" 1/2 3"	E1	2"

DIMENSIONAL DRAWINGS

Data Book
FX-W-G05 0551 - 1752_202109_EN R513A

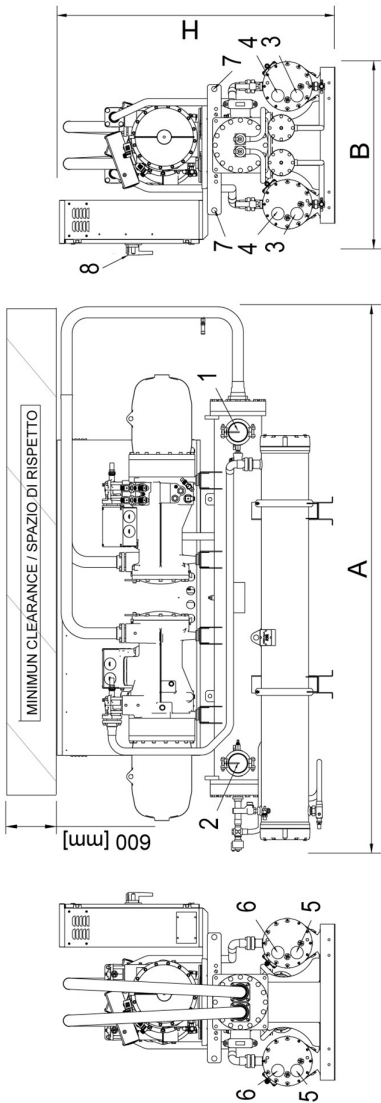

- 1 - EVAPORATOR WATER INLET
ENTRATA ACQUA EVAPORATORE

2 - EVAPORATOR WATER OUTLET
USCITA ACQUA EVAPORATORE

3 - CONDENSER WATER INLET
ENTRATA ACQUA CONDENSATORE


4 - CONDENSER WATER OUTLET
USCITA ACQUA CONDENSATORE

5 - HEAT RECOVERY WATER INLET
ENTRATA ACQUA RECUPERATORE
- 6 - HEAT RECOVERY WATER OUTLET
USCITA ACQUA RECUPERATORE


7 - LIFTING POINTS
PUNTI DI SOLLEVAMENTO

8 - MAIN ISOLATOR
SEZIONATORE PRINCIPALE

9 - POWER INLET
INGRESSO LINEA ELETTRICA

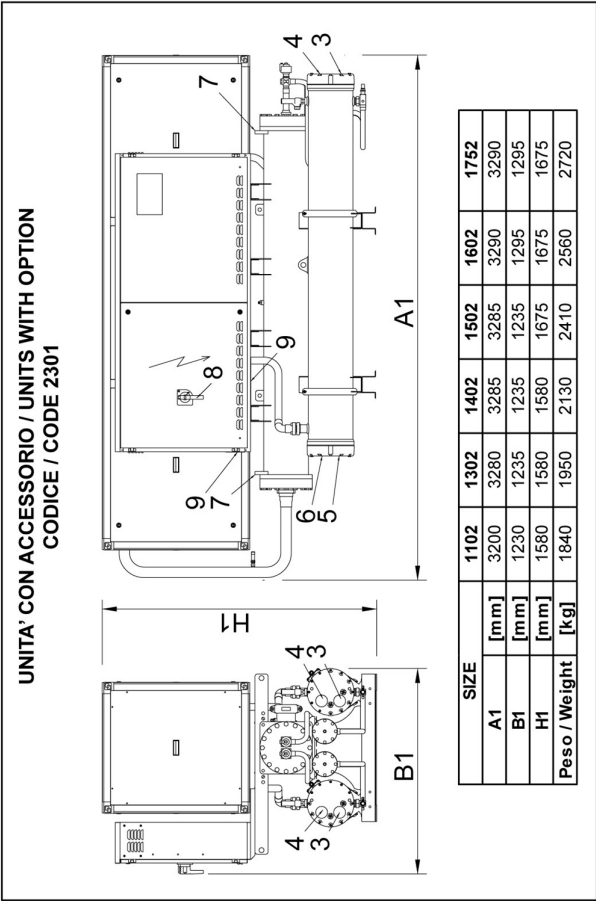

SIZE	1102	1302	1402	1502	1602	1752
A1	3200	3280	3285	3285	3290	3290
B1	1230	1235	1235	1235	1295	1295
H1	1580	1580	1580	1675	1675	1675
Peso / Weight	1840	1950	2130	2410	2560	2720

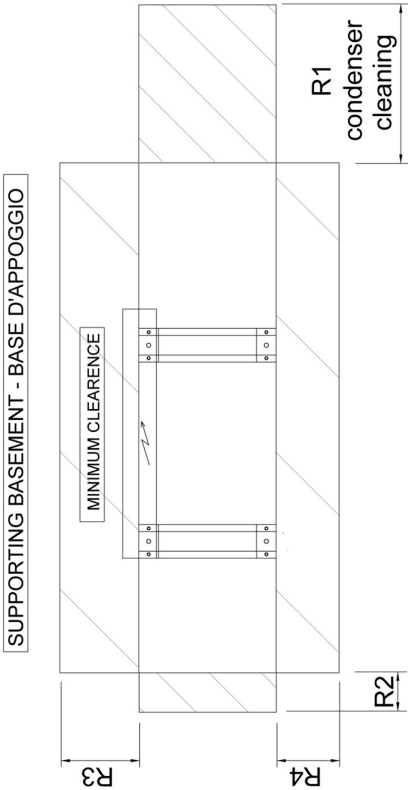

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS


Data Book

FX-W-G05 0551 - 1752_202109_EN R513A


[SI System]

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø	TYPE	Ø
FX-W-G05 /R /1102	3000	1250	1650	2019	2000	500	1000	800	H	4"	E1	2" 1/2	[E1] - Attacco filet	2" 1/2
FX-W-G05 /R /1302	3100	1250	1650	2123	2000	500	1000	800	H	4"	E1	2" 1/2	[E1] - Attacco filet	2" 1/2
FX-W-G05 /R /1402	3100	1250	1650	2406	2000	500	1000	800	H	4"	E1	2" 1/2	[E1] - Attacco filet	2" 1/2
FX-W-G05 /R /1502	3200	1250	1750	2806	2000	500	1000	800	H	5"	E1	2" 1/2	[E1] - Attacco filet	2" 1/2
FX-W-G05 /R /1602	3200	1350	1750	2892	2000	500	1000	800	H	5"	E1	3"	[E1] - Attacco filet	3"
FX-W-G05 /R /1752	3200	1350	1750	3082	2000	500	1000	800	H	5"	E1	3"	[E1] - Attacco filet	3"

12.2 Legend of pipe connections

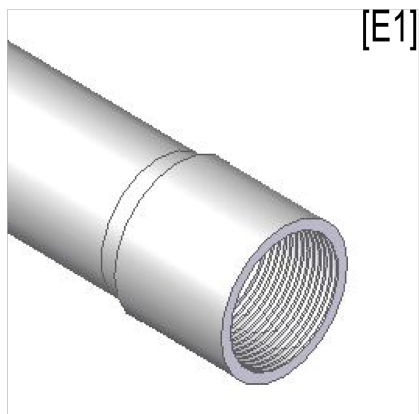**TYPE = E1**

[E1] - Female threaded pipe (UNI ISO 228/1 - G)

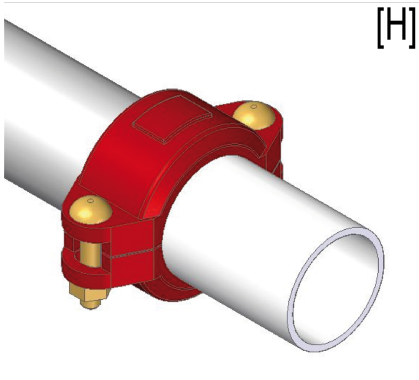**TYPE = H**

[H] - Grooved coupling with weld end counter-pipe user side

NOMINAL PIPE SIZE	PIPE OUTSIDE DIAMETER
ø inches	ø mm
3/4	26,7
1	33,7
1 1/4	42,4
1 1/2	48,3
2	60,3
2 1/2	76,1
3	88,9
3 1/2	101,6

NOMINAL PIPE SIZE	PIPE OUTSIDE DIAMETER
ø inches	ø mm
4	114,3
4 1/2	127,0
5	139,7
6	168,3
8	219,1
10	273,0
12	323,9
14	355,6

UNI ISO 228/13

Pipe threads where pressure-tight joints are not made on the threads - Designation, dimensions and tolerances

Used terminology:

G: Pipe threads where pressure-tight joints are not made on the threads
A: Close tolerance class for external pipe threads where pressure-tight joints are not made on the threads
B: Wider tolerance class for external pipe threads where pressure-tight joints are not made on the threads
Internal threads: G letter followed by thread mark (only tolerance class)
External threads: G letter followed by thread mark and by A letter for A class external threads or by B letter for B class external threads.

UNI EN 10226-1

Pipe threads where pressure-tight joints are made on the threads - Designation, dimensions and tolerances

Used terminology:

Rp: Internal cylindrical threads where pressure-tight joints are made on the threads

Rc: Internal conical threads where pressure-tight joints are made on the threads

R: External conical threads where pressure-tight joints are made on the threads

Internal cylindrical threads: R letter followed by p letter

Internal conical threads: R letter followed by c letter

External conical threads: R letter

NOTE:

Conventional diameter value [in inches] identifies short thread designation, based upon the relative standard.

All relative values are defined by standards.

13.1 Variable flow control

Pump energy consumption significantly impacts plant running costs, but it can be considerably reduced thanks to the use of variable speed pumps (inverter driven pumps), capable of adjusting the water flow rate according to the actual plant thermal load.

Mitsubishi Electric Hydronics & Cooling Systems has developed the VPF control series (Variable Primary Flow), that provides different water flow regulation logics specifically devoted to various hydraulic plant solutions: only a primary circuit, primary and secondary circuits, single unit or multi-unit systems controlled with external controller (Manager 3000, ClimaPRO) or with 1541, 1542 Multi Manager options.

The VPF systems adjust the pump speeds on the basis of the plant's thermal load and optimize the unit's thermoregulation algorithm for variable flow operation, in a dynamic and simultaneous way. This ensures the highest energy savings, stable operation, and complete reliability.


VPF SYSTEM (delta P control) For plants with only a primary circuit


VPF - Plant and unit requirements

The VPF logic provides the variable flow control for the plant's primary circuit.


- Type of plant: primary circuit only, that feeds hydronic terminals fitted with a 2-way regulating valve
- Hydronic module: modulating regulation devices (0-10V signal) or variable speed pumps
- Unit thermoregulation: control of the leaving water temperature
- Monitored parameter: delta P on relevant users' hydronic terminal

Plant diagram for single unit system

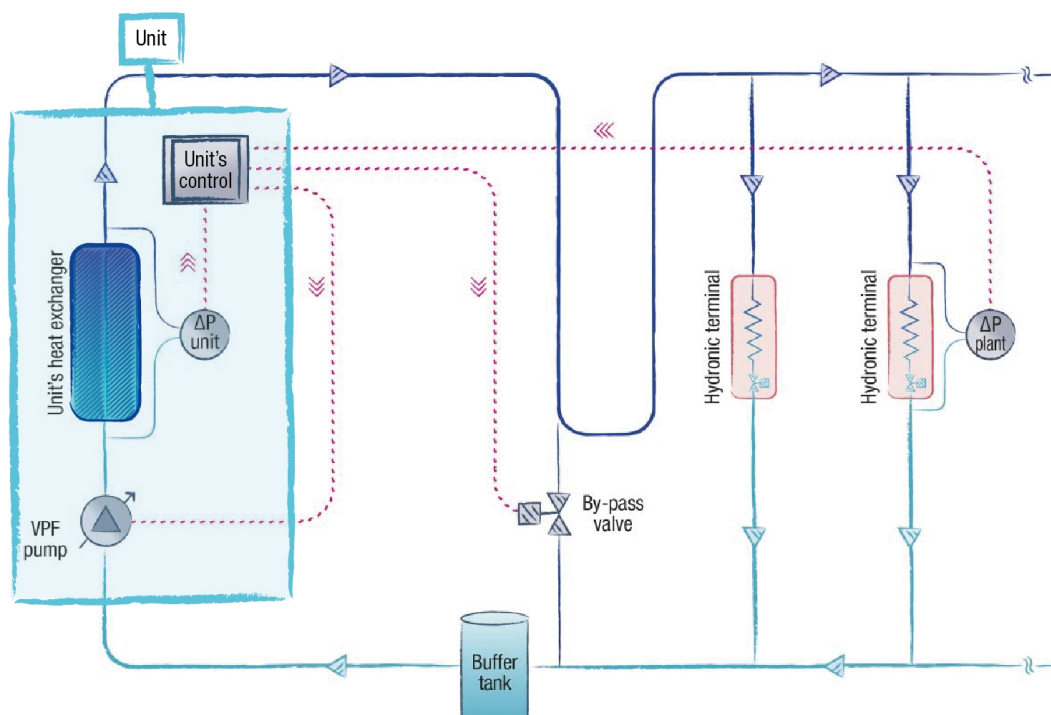

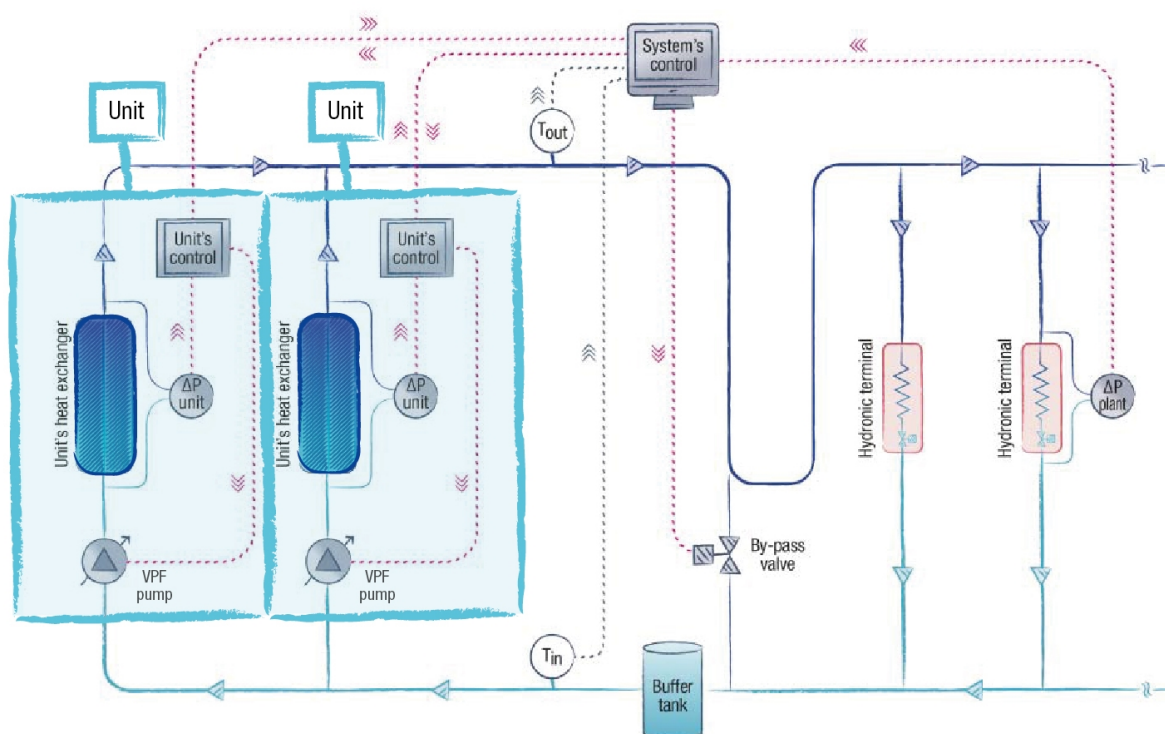Plant diagram for multi-unit with external control system (Manager3000 or ClimaPRO)

Plant diagram for multi-unit system with Multi Manager

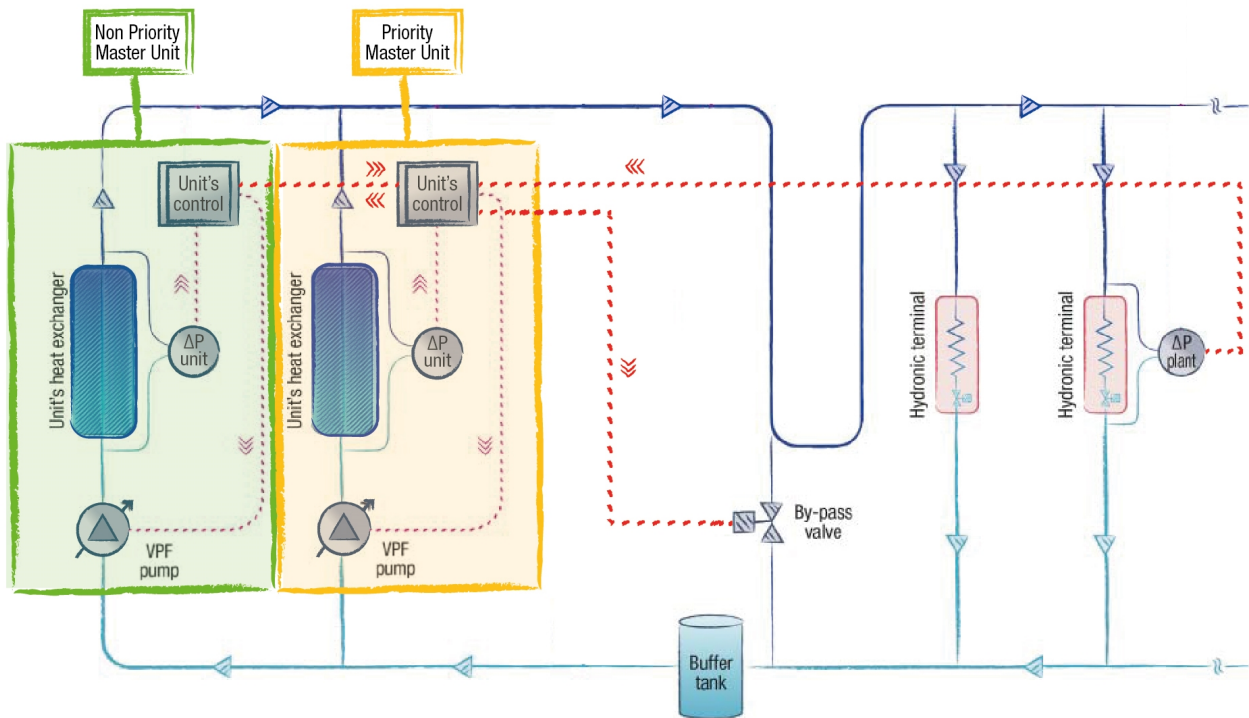

VPF - Operating logic

Water flow regulation

The VPF system monitors the differential pressure on the plant side (ΔP) and adjusts the pump speed in order to keep it within a defined range (ΔP_{min} ΔP_{max}).

- If $\Delta P_{min} \leq \Delta P \leq \Delta P_{max}$

The plant water flow is appropriate to the thermal load, the pump speed is kept constant.

- If $\Delta P > \Delta P_{max}$

The plant water flow exceeds what is necessary to properly cover the thermal load, the pump speed is reduced to save pump energy.

- If $\Delta P < \Delta P_{min}$

The plant water flow is too low to ensure the proper feed to the hydronic terminals, the pump speed is increased.

With the VPF system, the water flow can be reduced to 50% of the unit nominal water flow, with regards to the selection conditions, provided that the minimum water flow required by the unit's heat exchanger is respected (the control of the heat exchanger's minimum water flow is described below).

The pump speed regulation is performed with little progressive adjustments while continuously monitoring the values of both the ΔP on the plant side and the water temperature on the heat exchanger. The absence of abrupt water flow changes prevents fluctuation due to possible conflicts with the unit's thermoregulation function (compressor regulation).

Control of the unit's minimum water flow

Under no circumstances can the primary circuit water flow be reduced below the minimum water flow required by the unit's heat exchanger.

The monitoring of the unit's water flow is performed through a factory installed differential pressure transducer on the unit's heat exchanger.

If the differential pressure on the plant side requests a users' water flow lower than the unit's minimum water flow, the VPF system commands the gradual opening of the hydraulic by-pass valve (safety function). This ensures that the minimum water flow required by the unit's heat exchanger is always provided. As soon as the hydronic terminals request an increase of the water flow ($\Delta P < \Delta P_{min}$), the VPF closes the by-pass valve.

Multi-unit systems

The VPF control logic is also the same for multi-unit systems.

The plant side differential pressure transducer reading and the by-pass valve opening are managed by the multi-unit control system (Manager3000, ClimaPRO, Multi Manager Master).

Each unit autonomously adjusts its pump speed on the basis of the information provided by the multi-unit control system.

When the plant load requests the activation of a stand-by unit, the multi-unit control system calculates the starting speed of its pump in order to avoid excessive water flow variation of the running units.

In case of multi-unit system with Multi Manager, at least one unit must be set as Priority Master (opt 1541). To grant redundancy to the system, more than one unit can be configured as Priority Master. All the Priority Masters must be connected to the differential pressure transducer and the by-pass valve. The Multi Manager system only takes into account the signal read and sent by the Master of the moment (a specific filtering device is part of the supply; see the table below, note (8)).

The Non Priority Master cannot be connected to differential pressure transducer and by-pass valve and cannot managed the VPF function. In the event that a Non Priority Master is elected as the Master of the system, the VPF function is suspended.

ATTACHMENTS

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

VPF - Devices and installation

Device	Accessory name		
	VPF (w/o DP)(SU, MM_PR) ⁽¹⁾	VPF (w DP)(SU, MM_PR) ⁽²⁾	VPF (M3000, CPRO, MM_N-PR) ⁽³⁾
Differential pressure transducer on the unit's heat exchanger and related controller expansion board	Factory installed	Factory installed	Factory installed
Controller expansion board to read the plant side differential pressure transducer (4-20mA signal) and manage the hydraulic by-pass valve opening (0-10V signal)	Factory installed	Factory installed	Factory installed on the multi-unit external control system (Manager3000, ClimaPRO) Not included with option 1542 (Non Priority Master unit) ⁽⁵⁾
Plant side differential pressure transducer	Not included (the supply is the customer's responsibility) ⁽⁴⁾	Factory supplied, installation is the client's responsibility ⁽⁴⁾⁽⁵⁾	Factory supplied with the multi-unit external control system (Manager3000, ClimaPRO); installation is the client's responsibility Not included with option 1542 (Non Priority Master unit) ⁽⁴⁾⁽⁶⁾
Plant side hydraulic by-pass valve	Not included (the supply is the customer's responsibility) ⁽⁷⁾⁽⁸⁾	Not included (the supply is the customer's responsibility) ⁽⁷⁾⁽⁸⁾	Not included (the supply is the customer's responsibility) ⁽⁷⁾

(1) VPF for unit without plant differential pressure transducer included (for single unit plant and Priority Master unit)

(2) VPF for unit with plant differential pressure transducer included (for single unit plant and Priority Master unit)

(3) VPF for multi-unit plant with external controller (Manager3000, ClimaPRO) and Non Priority Master unit

(4) It is recommended to install the differential pressure transducer on the most hydraulically critical hydronic terminal, to ensure it has a proper water flow in any load condition.

(5) Technical features of the differential pressure transducer supplied:

Model: Huba Control 692.9 120071C1

Pressure range: 0 ... + 1 bar

Output: 4-20mA

Electrical connection: DIN EN 175301-803-A (IP 65)

Pressure connection adapters: male threaded G 1/8"

(6) It is the customer's responsibility to configure the multi-unit control system (Manager3000, ClimaPRO or Multi Manager) with option VPF.

(7) See attached table for information on the hydraulic by-pass design.

(8) In case of a multi-unit plant with more than one Master Priority unit (opt 1541) please specify it when emailing our sales. An additional device will be added to manage the multiple signals coming from unit's controller to the by-pass valve.

The following table provides the indications for a correct hydraulic by-pass design.

Heat exchanger minimum flow (m ³ /h) ⁽¹⁾	Minimum by-pass diameter	Minimum by-pass valve diameter	Suggested valve model	Kvs	Suggested actuator model
From 19 to 30	DN50 (2")	DN50 (2")	VVG41.50	40	SKB60
Up to 37	DN65 (2" ½)	DN65 (2" ½)	VVF31.65	49	SKB60
Up to 60	DN80 (3")	DN80 (3")	VVF31.80	78	SKB60
Up to 95	DN100 (4")	DN100 (4")	VVF31.90	124	SKC60
Up to 150	DN125 (5")	DN125 (5")	VVF31.91	200	SKC60
Up to 230	DN150 (6")	DN150 (6")	VVF31.92	300	SKC60

((1) In case of a multi-unit system, the unit with the highest minimum water flow should be the reference.

ATTACHMENTS

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

VPF.D SYSTEM (delta T control)


For plants with primary and secondary circuits separated by a hydraulic decoupler.

VPF.D - Plant and unit requirements

The VPF.D logic provides the variable flow control for the plant's primary circuit.

- Type of plant: primary and secondary circuits separated by a hydraulic decoupler
- Hydronic module: modulating regulation devices (0-10V signal) or variable speed pumps
- Unit thermoregulation: control of the leaving water temperature
- Monitored parameter: delta T on primary circuit

Plant diagram for multi-unit with external control system (Manager3000 or ClimaPRO)

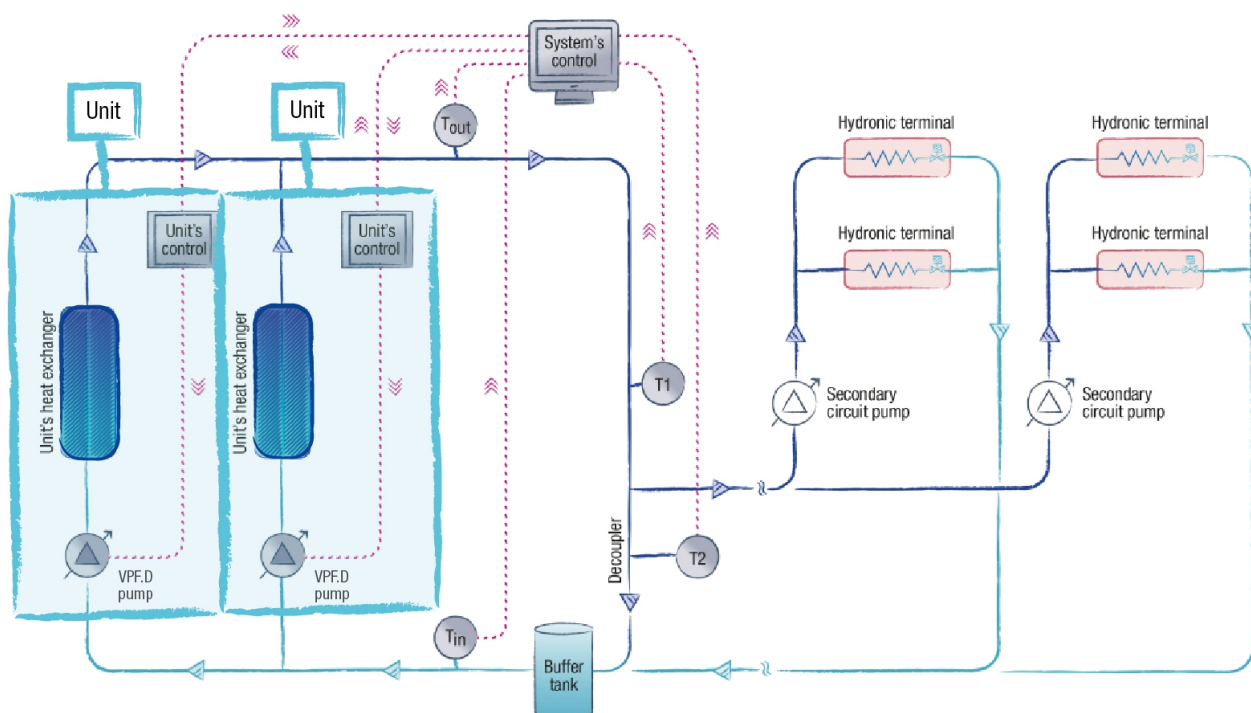


ATTACHMENTS


Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

Plant diagram for single unit system

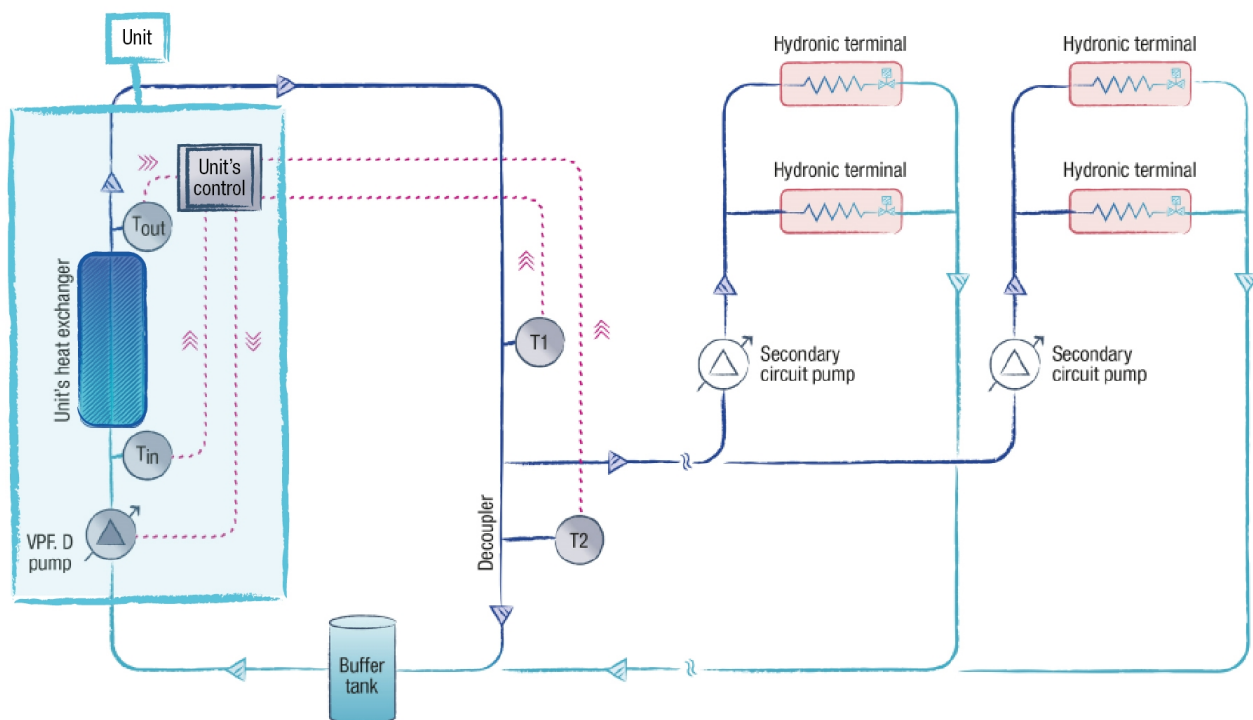

Plant diagram for multi-unit system with Multi Manager

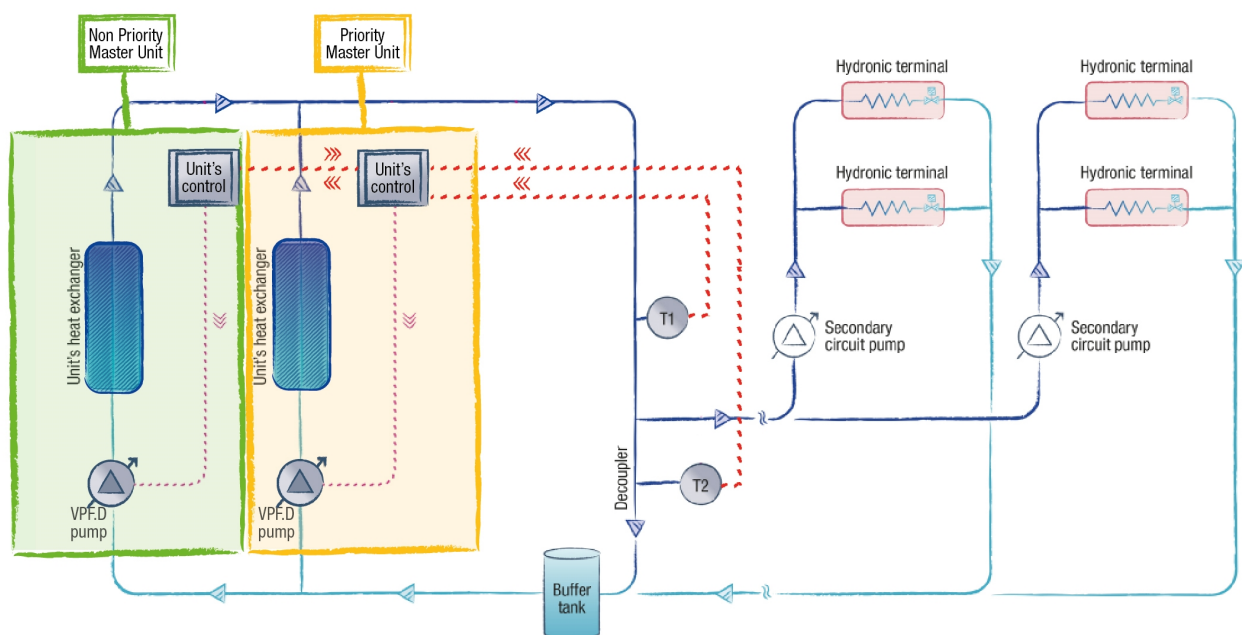

VPF.D - Operating logic

Water flow regulation

The VPF.D system monitors the temperature difference of the primary circuit (ΔT) (that corresponds to the temperature difference of the unit's heat exchanger in the case of a single unit system), and adjusts the primary circuit's pump speed in order to keep it within a defined range ($\Delta T_{min} \leq \Delta T \leq \Delta T_{max}$). The secondary circuit water flow is completely independent and is to be managed by the client.

- If $\Delta T_{min} \leq \Delta T \leq \Delta T_{max}$

The plant water flow is appropriate to the thermal load, the pump speed is kept constant.

- If $\Delta T < \Delta T_{min}$

The plant water flow exceeds what is necessary to properly cover the thermal load, the pump speed is reduced to save pump energy.

- If $\Delta T > \Delta T_{max}$

The plant water flow is too low to ensure the proper feed to the users, the pump speed is increased.

To prevent the returning water of the secondary circuit from recirculating through the decoupler and mixing with the delivery water, which would cause serious plant regulation problems, the VPF.D provides a safety function based on the temperatures, which are detected by two probes on the plant side: T1 on the unit delivery line and T2 on the hydraulic decoupler. If during the water flow regulation of the circuits, the flow direction in the decoupler reverses (detected temperatures $T1 < T2$), the system forces a quick increase of the primary water flow until the correct direction of the flow in the decoupler is restored (detected temperatures $T1 = T2$).

With the VPF.D system, the water flow can be reduced to 50% of the unit nominal water flow, with regards to the selection conditions, provided that the minimum water flow required by the unit's heat exchanger is respected (the control of the heat exchanger's minimum water flow is described below).

The pump speed regulation is performed with little progressive adjustments while continuously monitoring the values of both the temperature difference on the primary circuit and the temperatures of the probes T1 and T2. The absence of abrupt water flow changes prevents fluctuation due to possible conflicts with the unit's thermoregulation function (compressor regulation).

Control of the unit's minimum water flow

Under no circumstances can the primary circuit water flow be reduced below the minimum water flow required by the unit's heat exchanger.

The unit's minimum water flow is ensured by setting the minimum pump speed (service menu parameter).

ATTACHMENTS

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

Multi-unit systems

The VPF.D control logic is also the same for multi-unit systems.

The reading of the temperature difference on the primary circuit and the reading of the temperature probes T1 and T2 is managed by the multi-unit control system (Manager3000, ClimaPRO, Multi Manager Master). Each unit autonomously adjusts its pump speed on the basis of the information provided by the multi-unit control system.

When the plant load requests the activation of a stand-by unit, the multi-unit control system calculates the starting speed of its pump in order to avoid excessive water flow variation of the running units.

In case of multi-unit system with Multi Manager, at least one unit must be set as Priority Master (opt 1541). To grant redundancy to the system, more than one unit can be configured as Priority Master. All the Priority Masters must be connected to the temperature probes T1 and T2. The Multi Manager system only takes into account the signal read and sent by the Master of the moment.

The Non Priority Master cannot be connected to the temperature probes T1 and T2, and cannot managed the VPF.D function. In the event that a Non Priority Master is elected as the Master of the system, the VPF.D function is suspended.

VPF.D - Devices and installation

Dispositivo	Accessory name	
	VPF.D (SU, MM_PR) ⁽¹⁾	VPF.D(M3000, CPRO, MM_N-PR) ⁽²⁾
2 plant side NTC temperature sensors and related controller expansion board	Factory supplied (probes supplied without wells), installation is the client's responsibility ⁽³⁾	Factory supplied with the multi-unit external control system, Manager3000 or ClimaPRO (probes supplied without wells); installation is the client's responsibility Not included with option 1542 (Non Priority Master unit) ⁽³⁾⁽⁴⁾

(1) VPF.D for single unit plant and Priority Master unit

(2) VPF.D for multi-unit plant with external controller (Manager3000 or ClimaPRO) and Non Priority Master unit

(3) It is recommended to install the temperature probes as shown in the enclosed plant diagrams (T1 on the unit delivery line, T2 on the hydraulic decoupler)

(4) It is the customer's responsibility to configure the multi-unit control system (Manager3000, ClimaPRO or Multi Manager) with option VPF.D.

The following table provides the indications for a correct hydraulic decoupler design.

Heat exchanger minimum flow (m ³ /h) ⁽¹⁾	Minimum hydraulic decoupler diameter
From 25 to 40	DN65 (2" ½)
Up to 60	DN80 (3")
Up to 100	DN100 (4")
Up to 150	DN125 (5")
Up to 225	DN150 (6")
Up to 375	DN200 (8")

(1) In case of a multi-unit system, the unit with the highest minimum water flow should be the reference.

13.2 Condensation control devices

2-WAY modulating valve

Two way servo-motorized valve with steel body, recommended for well water applications, and in general for applications with variable water flow.

The valve is selected for a Delta T of 10°C (12/7 °C e 15/25°C).

2-way vie	kvs	DN	Dp max	Qmin	Qmax	Actuator
Type	[m³/h]		[kPa]	[m³/h]	[m³/h]	Type
A	10	25	300	6.5	10	0-10 V
B	16	32	300	10	16	0-10 V
C	25	40	300	16	25	0-10 V
D	40	50	300	25	40	0-10 V
E	50	65	300	32	50	0-10 V
F	63	65	300	40	63	0-10 V
G	80	80	300	51	80	0-10 V
H	100	80	300	63	100	0-10 V

ATTACHMENTS

Data Book

FX-W-G05 0551 - 1752_202109_EN R513A

In the chart below:

Line (A): curve of the 2-way valve for units size 0551, 0651, 0751, 1102, 1302, 1402, 1502

Line (B): curve of the 2-way valve for units size 0551-1752

Line (C): curve of the 2-way valve for units size 0551-1752


Line (D): curve of the 2-way valve for units size 0551-1752

Line (E): curve of the 2-way valve for units size 0551-1752

Line (F): curve of the 2-way valve for units size 0551-1752

Line (G): curve of the 2-way valve for units size 0851, 0951, 1602, 1752

Line (H): curve of the 2-way valve for units size 0851, 0951, 1752

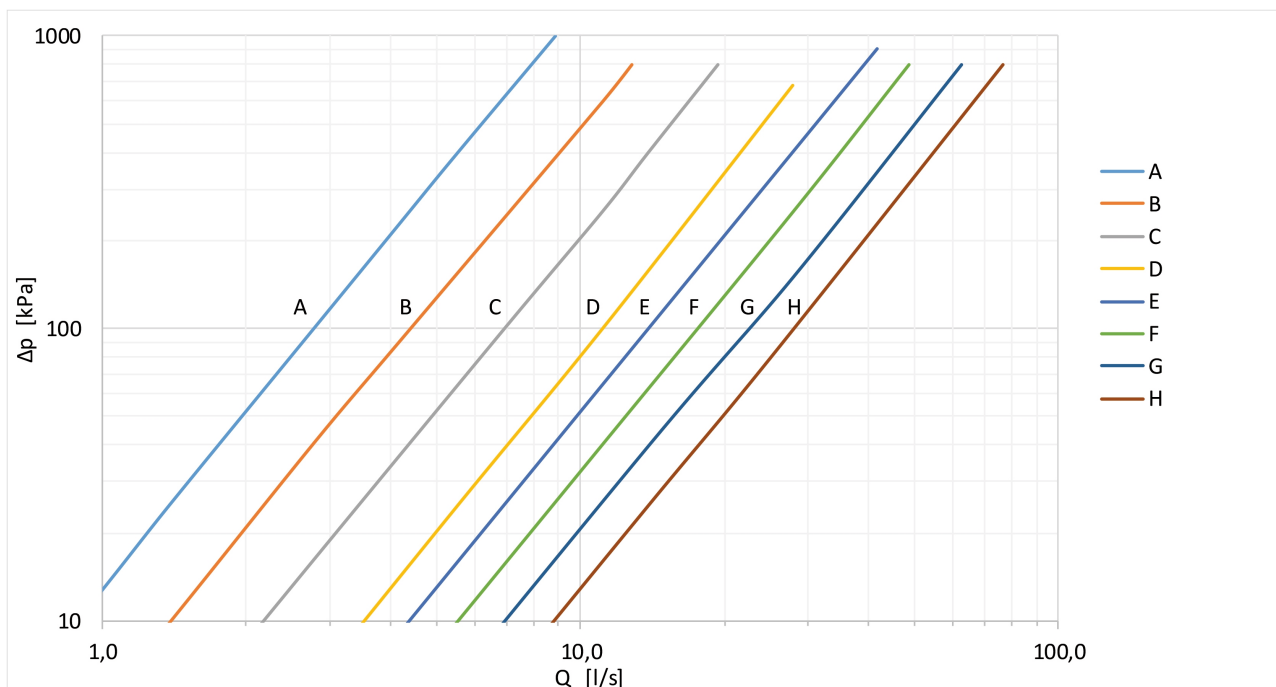

MITSUBISHI ELECTRIC HYDRONICS & IT COOLING SYSTEMS S.p.A.

Head Office:

Via Caduti di Cefalonia 1 - 36061 Bassano del Grappa (VI) - Italy

Tel (+39) 0424 509 500 - Fax (+39) 0424 509 509

www.melcohit.com